

ATTACHMENT WHS – 3

PSNH FOSSIL STEAM UNIT AVAILABILITY

PSNH Fossil Steam Unit Availability
January 2007 through December 2007

	Merrimack Unit 1	Merrimack Unit 2	Newington Unit 1	Schiller Unit 4	Schiller Unit 5	Schiller Unit 6
January	100.0%	100.0%	100.0%	98.3%	59.4%	88.4%
February	100.0%	86.8%	100.0%	100.0%	74.4%	92.5%
March	88.6%	100.0%	96.5%	85.6%	98.0%	19.0%
April	100.0%	55.3%	55.7%	98.9%	69.2%	54.7%
May	100.0%	18.3%	100.0%	99.2%	96.4%	80.3%
June	91.9%	97.3%	100.0%	100.0%	77.7%	79.5%
July	100.0%	100.0%	100.0%	99.9%	88.1%	100.0%
August	100.0%	100.0%	99.5%	99.8%	100.0%	100.0%
September	88.7%	78.9%	100.0%	100.0%	83.7%	87.0%
October	100.0%	87.4%	97.9%	88.2%	62.3%	100.0%
November	100.0%	100.0%	100.0%	100.0%	83.4%	100.0%
December	100.0%	100.0%	99.8%	100.0%	100.0%	100.0%

Planned Maintenance Outages
January 2007 through December 2007


<u>Unit</u>	<u>Month(s)</u>
Merrimack 1	No A.I. in 2007
Merrimack 2	Apr, May
Newington	Mar, Apr
Schiller 4	No A.I. in 2007
Schiller 5	Apr, Oct, Nov
Schiller 6	Mar, Apr

DEFINITION:




Equivalent Availability Factor - EAF:

$$\frac{(\text{Available Hours} - \text{Equiv. Unit Derated Hours} - \text{Equiv. Seasonal Derated Hours}) \times 100}{\text{Period Hours}}$$




PSNH FOSSIL SYSTEM WEIGHTED EAF
2007

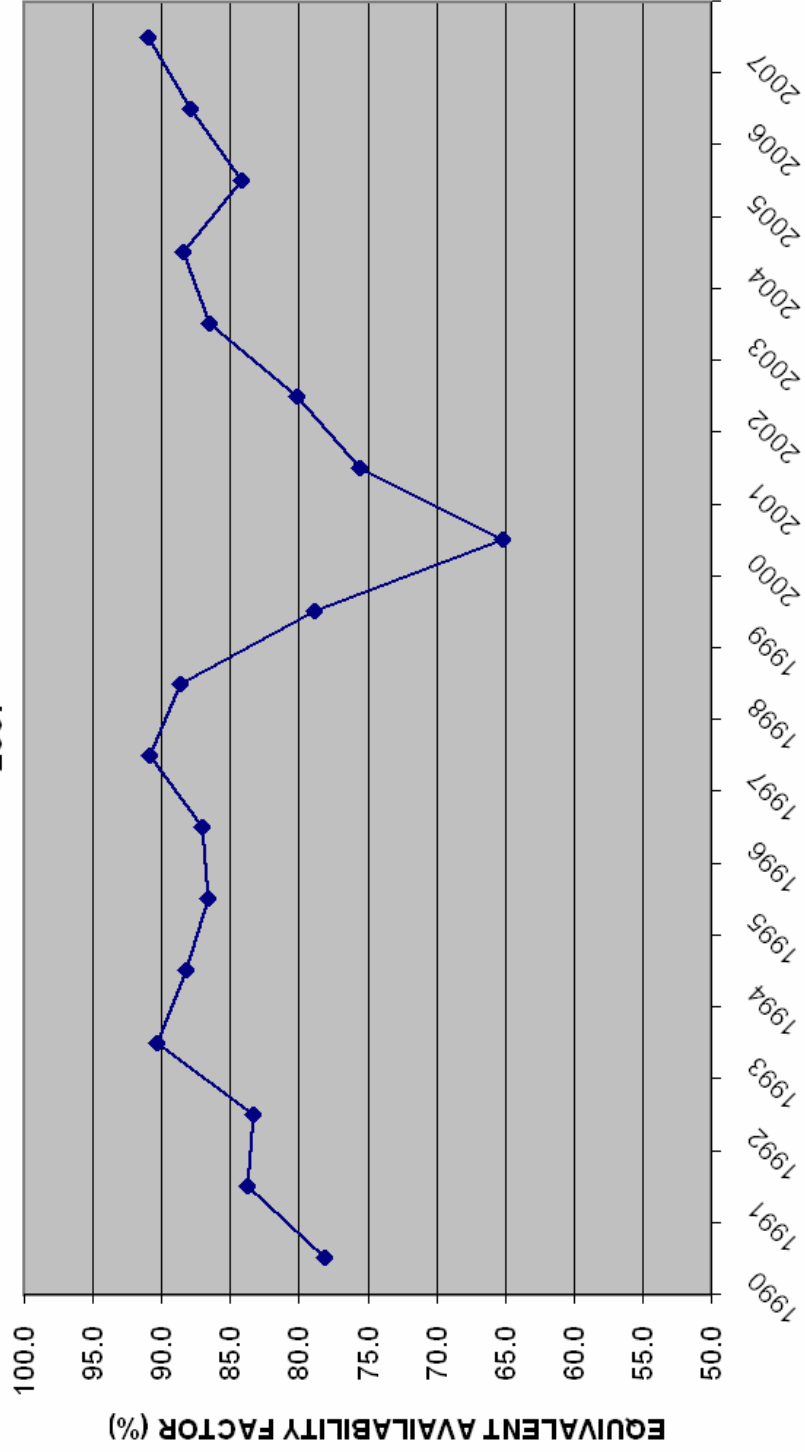




Fossil Plant Graphs – Planned Outages Included

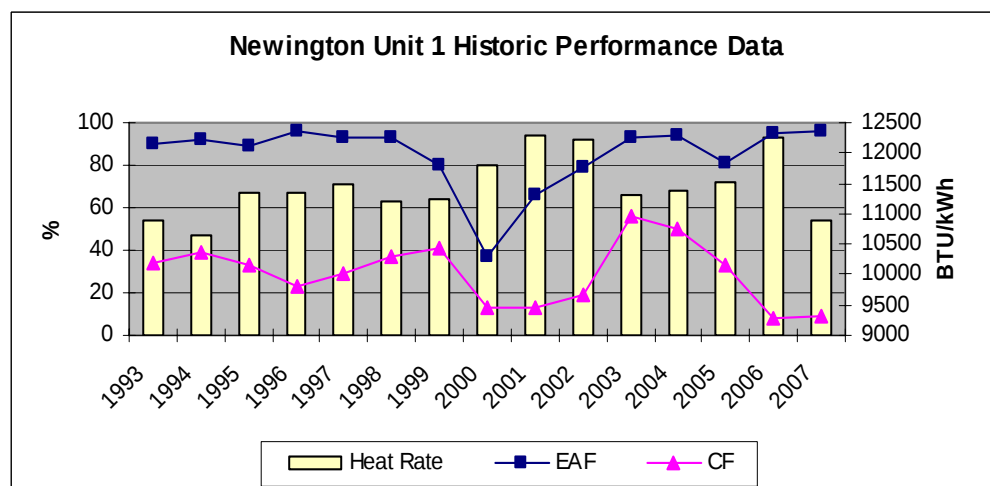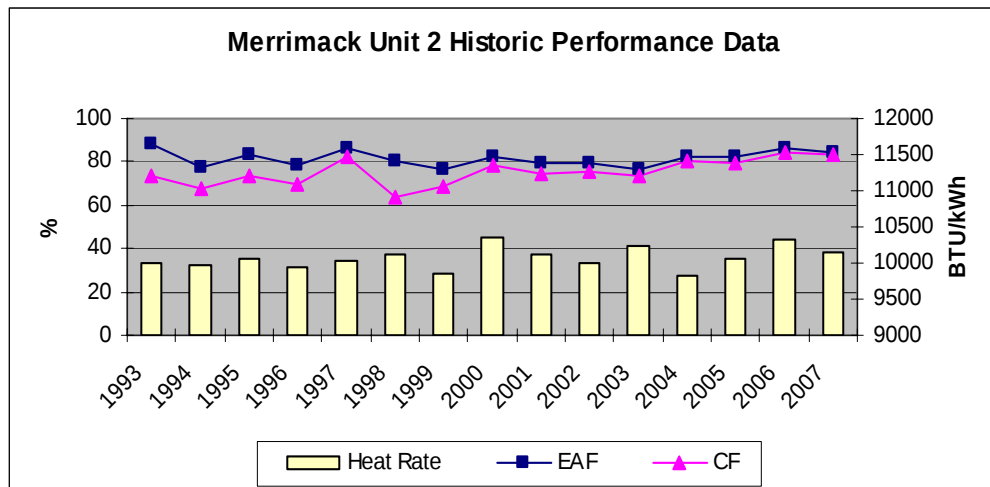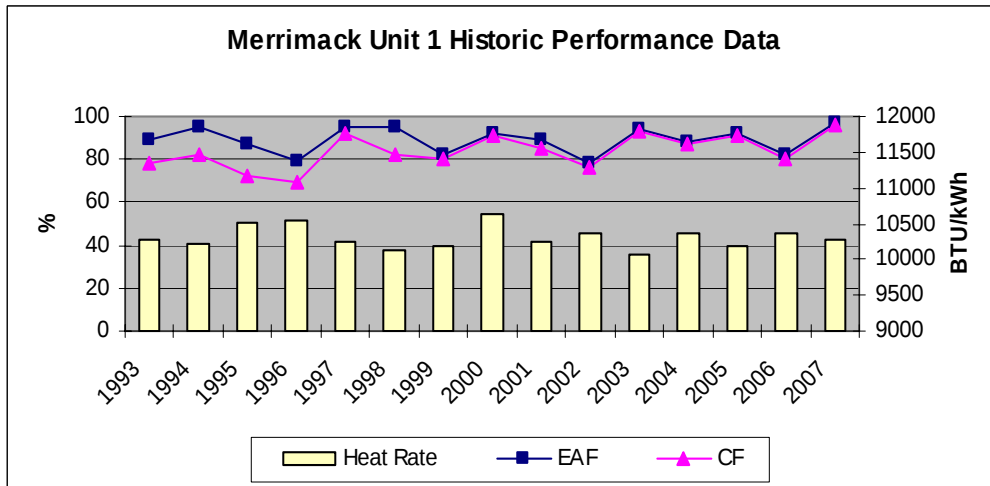

Fossil Plant Graphs – Planned Outages Included

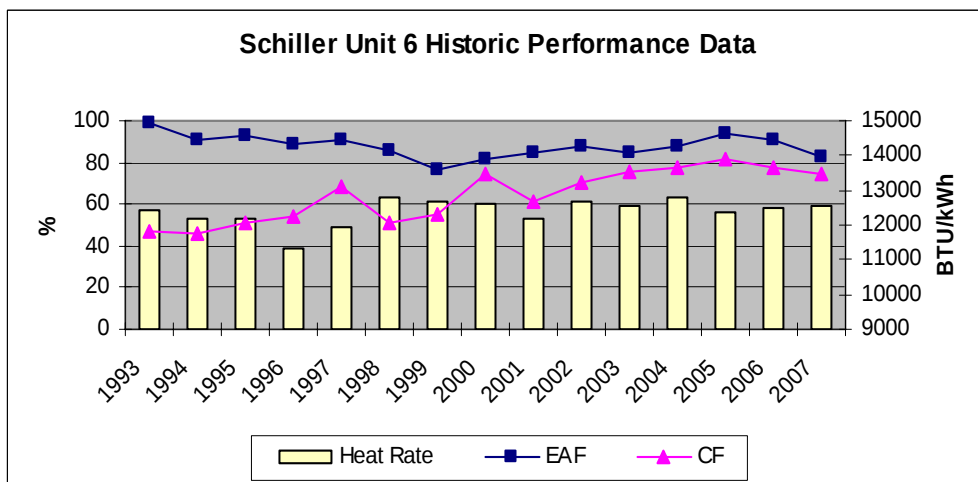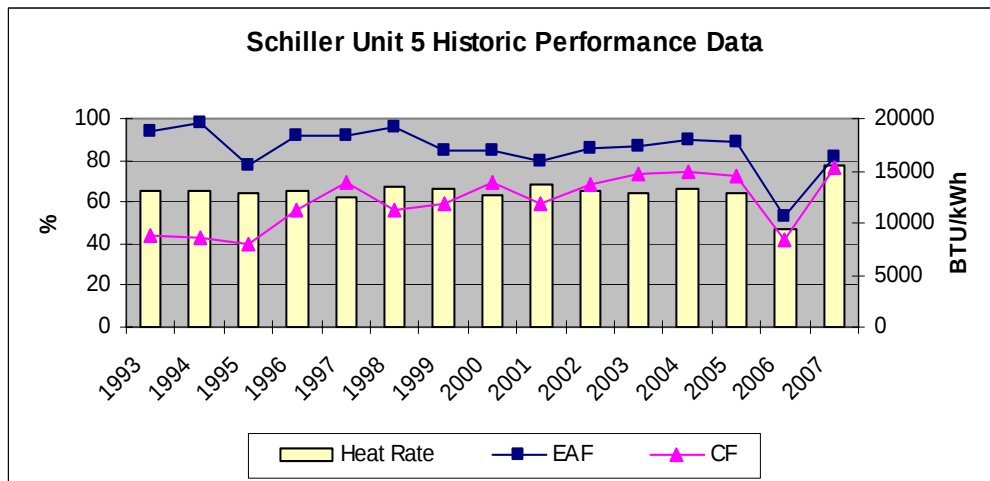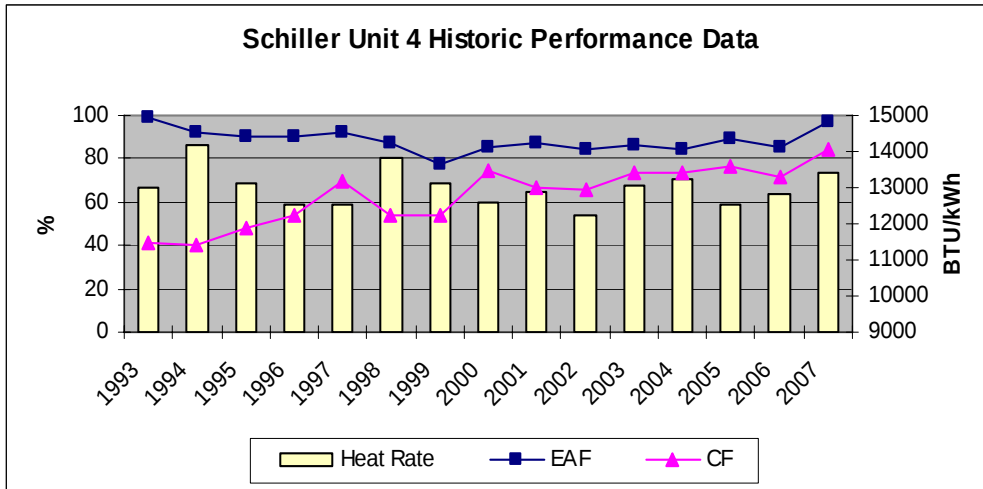

Fossil Plant Graphs – Planned Outages Omitted

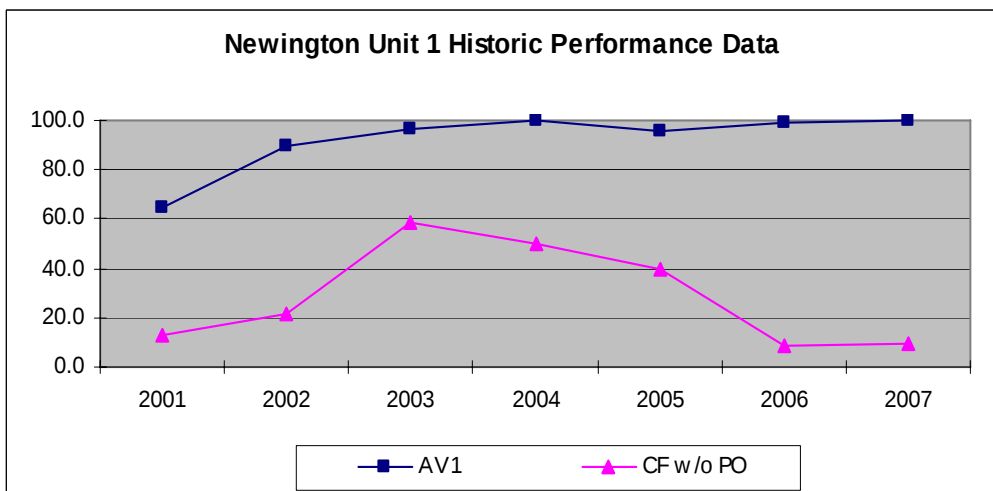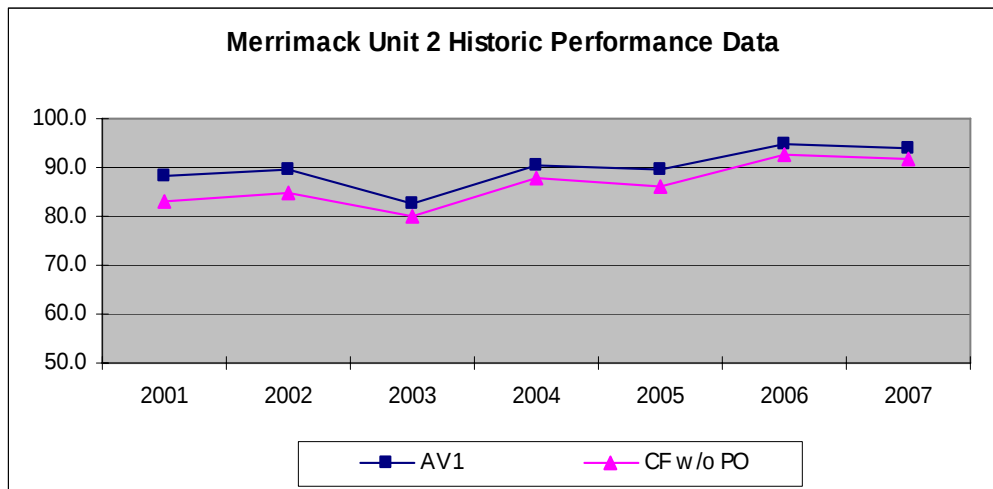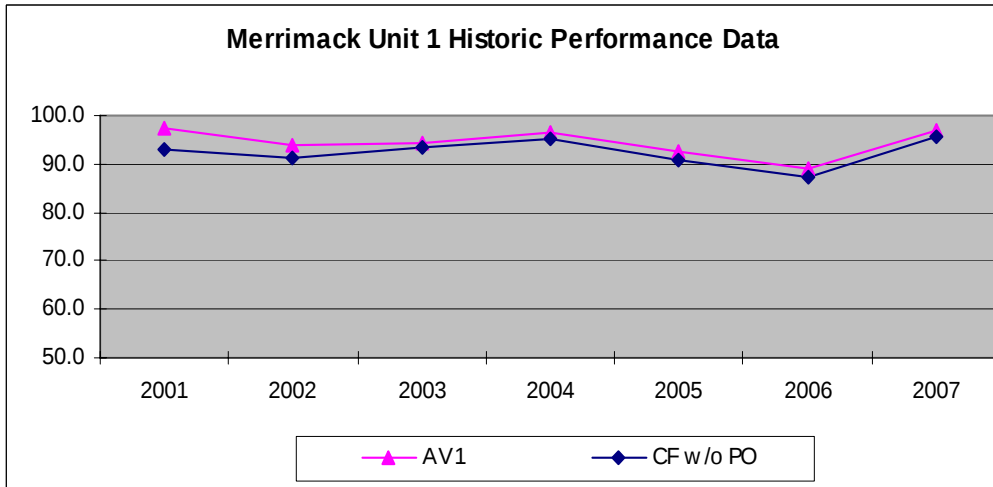

Fossil Plant Graphs – Planned Outages Omitted

