

STATE OF NEW HAMPSHIRE
PUBLIC UTILITIES COMMISSION

DOCKET NO. DE 19-057

IN THE MATTER OF: **PUBLIC SERVICE COMPANY OF NEW
HAMPSHIRE D/B/A EVERSOURCE ENERGY**

Distribution Service Rate Case

REDACTED

DIRECT TESTIMONY

OF

AGUSTIN J. ROS

December 20, 2019

TABLE OF CONTENTS

I. Introduction.....	4
II. Background on Electricity MCOS Studies	5
III. Eversource MCOS Study	8
A. Primary Distribution System.....	10
B. Local Distribution Facilities	17
C. Marginal Customer Costs	19
D. Operations and Maintenance Costs.....	22
E. Development of Costing Periods for Time Differentiation	22
IV. Analysis.....	23

LIST OF ATTACHMENTS

AJR-1	Curriculum Vitae of Agustin Ros
AJR-2	Eversource Response to Staff 14-002, Attachment Staff 14-002
AJR-3	Confidential Eversource Response to OCA 2-51, Attachment E
AJR-4	Eversource Response to Staff 14-041
AJR-5	Confidential Eversource Response to OCA 6-105, Attachment D
AJR-6	Confidential Eversource Response to OCA 2-051, Attachment A
AJR-7	Eversource Response to Staff 14-040
AJR-8	Eversource Response to Staff 14-007
AJR-9	Confidential Eversource Response to Staff 14-043, Attachment Staff 14-043
AJR-10	Eversource Response to Staff 14-042
AJR-11	Eversource Response to Staff 14-036
AJR-12	Eversource Response to OCA 7-014, Attachment Replacement OCA 2-51 Attachment G
AJR-13	Eversource Response to, OCA 2-051, Attachment H
AJR-14	Confidential Eversource Response to OCA 2-051, Attachment F
AJR-15	Confidential Eversource Response to Staff 14-038

1 **I. INTRODUCTION**

2 **Q. Please state your name, address, employer, position, and professional**
3 **qualifications.**

4 A. My name is Agustin J. Ros, and I am a Principal at the Brattle Group. My expertise is
5 in public utility economics including electricity cost of service and performance-based
6 ratemaking, competition and market power analysis, demand studies and econometric
7 modelling. I teach a class at the annual Edison Electric Institute (“EEI”) Advanced
8 Rate Course in Madison, Wisconsin, on embedded and marginal cost of service as well
9 as efficient rate design principles and practices. I am an Adjunct Professor at the
10 International Business School at Brandeis University where I teach a course on
11 regulation and antitrust economics with a focus on public utilities. My research on
12 public utility and competition issues has been published in *Public Utilities Fortnightly*,
13 *The Electricity Journal*, *The Energy Journal*, *The Journal of Regulatory Economics*,
14 *The Review of Industrial Organization*, *The Review of Network Economics*,
15 *Telecommunications Policy* and *Info*. I have a B.A. in economics from Rutgers
16 University and an M.S. and Ph.D. in economics from the University of Illinois at
17 Champaign-Urbana. I attach my CV as an Attachment, AJR-1.

18 **Q. Please describe the scope of your testimony.**

19 A. The Staff of the New Hampshire Public Utilities Commission asked me to review and
20 comment on the marginal cost of service (“MCOS”) study that Eversource Utilities
21 submitted in this proceeding. Eversource witness Amparo Nieto prepared the
22 Eversource MCOS study (“the Eversource Study” or “the Study”) and describes the
23 methodology and approach in her direct testimony.

24 **Q. Please describe your general approach to reviewing the Eversource Study.**

25 A. I reviewed the general methodology and approach that the Study used with respect to
26 the different components of the distribution marginal costs to determine whether the
27 approach is generally consistent with underlying economic costing theory and practice.

1 I also reviewed and checked much of the underlying data analysis used in the Study.
2 My review of the methodology and underlying data analysis led me to submit a number
3 of data requests to answer doubts I had about particular issues and to clarify and explain
4 why certain decisions were made.

5 **Q. How is your testimony structured?**

6 A. In Section II, I provide background on electricity marginal costs and lay out some
7 general approaches and practices to estimate electricity marginal costs and to assess the
8 Eversource Study. In Section III, I provide a detailed discussion of the main elements
9 of the Eversource Study including the primary and local distribution systems and
10 facilities, the customer costs, Operations and Maintenance (“O&M”) and Costing
11 Period for Time Differentiation. Lastly, in Section IV, I provide my analysis and
12 observations on some of the key aspects of the study and provide recommendations and
13 conclusions.

14

15 **II. BACKGROUND ON ELECTRICITY MCOS STUDIES**

16 **Q. Please define marginal costs.**

17 A. Marginal cost is the change in the total costs of providing a unit change in the output
18 of a good or service. Marginal cost is a forward-looking concept, examining and
19 estimating the economic resources that society will likely incur when producing an
20 additional unit of a good or service. The marginal cost concept is different from the
21 embedded cost concept, the main objectives of which are to assign and allocate the
22 historically incurred costs of providing a good or service.

23 The precise definition of marginal costs involves estimating the present value of the
24 cash flows caused by a permanent increase in production.¹ Specifically, marginal cost
25 is the difference between two incremental system costs where incremental system cost

¹ See Ralph Turvey, “Marginal Cost,” *The Economic Journal*, June 1969, for one of the earliest discussions on calculating marginal costs.

1 is the change in the cost of providing an increment of service and not just one additional
2 unit. The first incremental system cost is the change in the present value of the flow of
3 costs caused by a permanent increase in production. The second incremental system
4 cost reflects the same increase in production deferred by one year. The difference in
5 the two incremental cost flows is the first-year marginal cost. This calculation is known
6 as the deferral approach to calculating first-year marginal costs.

7 **Q. What are the different categories of marginal costs for electricity production?**

8 A. Electric utility marginal costs consist of three main categories: marginal capacity
9 costs—also referred to as marginal demand costs—marginal energy costs and marginal
10 customer costs. Marginal capacity costs are the change in total electricity costs
11 resulting from an increase in customers' peak-period (instantaneous) demands. In the
12 production of electricity, there are marginal generation, transmission and distribution
13 capacity costs. Marginal energy costs are the change in total electricity costs resulting
14 from an increase in the demand for energy during a particular interval in time. Marginal
15 energy costs consist of the fuel costs and the variable O&M expense required to
16 produce the energy as well as the energy losses associated with increased usage—*i.e.*,
17 transmitting electricity from the generation source to the load source necessarily entails
18 energy losses that need to be made up through additional generation to meet demand.
19 Marginal customer costs consist of the change in total electricity costs resulting from
20 an increase in the number of customers.

21 **Q. What are the relevant marginal costs for this proceeding?**

22 A. Eversource is an electricity distribution provider. Electricity distribution gives rise to
23 all three marginal costs concepts in theory—marginal capacity costs, marginal energy
24 cost and marginal customer costs—although in practice, the two main categories in an
25 electricity distribution MCOS study are marginal capacity costs and marginal customer
26 costs. Marginal energy costs in an MCOS distribution study are accounted for in the
27 loss factors. In the Eversource MCOS study, the two main categories of distribution
28 marginal cost analysis are the marginal capacity costs and the marginal customer costs
29 with loss factors to account for energy losses applied as a step within the MCOS study.

1 **Q. What are marginal costs used for in the regulation of the electricity sector?**

2 A. Marginal costs play an important role in the regulation of the electricity sector in that
3 they can be used for pricing and rate design objectives such as establishing dynamic
4 pricing and time of use/time of day rates and for setting appropriate price floors to
5 customers for competitive and economic development purposes. Marginal costs are
6 also used for internal resource planning, for company decision-making, and for
7 wholesale transactions. Marginal costs can also be used, in part, for cost allocation
8 purposes in a rate case proceeding.

9 **Q. What are the different types of methodologies that exist for calculating marginal**
10 **distribution costs?**

11 A. There are two commonly used methodologies for calculating marginal distribution
12 investment costs in theory. The first is the system planning approach and the second
13 is the use of statistical/regression analysis (“regression analysis”). Since the
14 Eversource Study uses the system planning approach, I describe that approach.

15 The system planning approach follows in the spirit of the marginal cost definition that
16 I discussed previously. Under the system planning approach, electricity engineers and
17 system planners determine the amount of distribution investment that is required in the
18 short- to medium-term due to an increase in peak demand and the cost analyst uses this
19 information to calculate marginal costs. Depending on the availability of the data, the
20 cost analyst performs the analysis for different parts of the distribution system, such as
21 the primary and secondary level. The result of this analysis is a marginal investment
22 per unit of demand, such as per MW or per kW. The cost analyst then annualizes the
23 investment using an economic carrying charge and accounts for additional shared
24 investments and expenses such as general plant, materials and services and
25 administrative and general services. Finally, the cost analyst estimates marginal O&M
26 expenses associated with the marginal investment and includes them in the MCOS
27 calculation.

1 **Q. How are marginal distribution O&M costs typically calculated in a marginal cost**
2 **of service study?**

3 A. A standard approach is to calculate O&M costs on a per-unit of output basis—*i.e.*,
4 calculate average per-unit O&M expenses—and to utilize that statistic as the value for
5 marginal O&M costs.² Specifically, the standard approach begins with historical data
6 on O&M costs for the different investment categories and converts those expenses into
7 an inflation-adjusted series, similar to the conversion that the cost analyst makes for
8 calculating marginal distribution investment. The next step is to convert the O&M
9 expenses to a per-unit level of peak demand—for plant-related O&M expenses—or a
10 per-unit level of customer demand—for customer-related O&M expenses—and
11 examine some basic statistics of that data series. The resultant statistics from the data
12 series—*i.e.*, the mean value for the series or the mean value for more recent years or
13 the use of a simple linear extrapolation—provides the O&M expenses that are added to
14 the annualized marginal investments discussed above.

15 **III. EVERSOURCE MCOS STUDY**

16 **Q. Please provide a high-level summary of the methodology of Eversource's MCOS**
17 **study.**

18 A. The Eversource Study adopts a system planning approach to calculate the marginal
19 distribution investment costs. The Study divides the Eversource system into five
20 different cost centers: Bulk Station, Non-Bulk Station, Trunk-Line, Local Distribution
21 Facilities, and Customer. The Bulk Station, Non-Bulk Station, and Trunk-Line cost
22 centers all relate to primary distribution. For each cost center, the Eversource Study
23 develops an estimate of the budgeted investment and then unitizes that cost on a
24 capacity (per kW) or per customer basis. The unitized costs are then multiplied by a
25 Real Economic Carry Charge (“RECC”) and “loaders” including O&M. These cost

² See National Association of Regulatory Utility Commissioners, *Electric Utility Cost Allocation Manual*, January, 1992, (“*NARUC Manual*”) Chapter 10, p. 131 for a discussion on calculating marginal O&M expenses for transmission capacity costs, an approach that is applicable to O&M expenses for distribution capacity costs.

1 centers and the unitization approach are summarized in Figure 1. I describe the
2 calculation details for each of these cost centers in the following sections.

3 **Figure 1: Eversource MCOS Cost Centers and Unitized Cost Approaches**

Category	Description	Unitized Cost Approach
Primary Distribution – Bulk Station	Converts load from transmission system (115 kV) to 34.5 kV or 12 kV.	\$/kW incremental capacity
Primary Distribution – Non-Bulk Station	Converts load from bulk station of 12 kV or 4 kV.	\$/kW incremental capacity
Primary Distribution – Trunk-Line	Connects bulk and non-bulk substations to local primary taps.	\$/kW incremental capacity
Local Distribution Facilities	Primary taps, line transformers, and secondary lines.	\$/kW design demand
Customer	Meter costs, customer service drop costs, and customer accounts and customer expenses.	\$/customer


4 Source: Nieto Direct; pp. 10-12; Bates 001737-39.

5 **Q. Do each of the cost centers contribute equally to the MCOS by rate class?**

6 A. No. For some classes, the largest components are the Local Distribution Facilities and
7 Customer costs, while for others the Bulk Station and Customer costs have the largest
8 impact, as shown in Figure 2. Although the Bulk Station costs are a large component
9 for a few rate classes, these are relatively small rate classes and overall the total
10 contribution of the Bulk and Non-Bulk Stations in the MCOS is small. Because
11 Eversource did not identify any investments over the 5-year period, the marginal cost
12 for the Trunk-Line cost center is zero.

Redacted

Figure 2: Breakdown of Marginal Cost by Cost Center and Rate Class

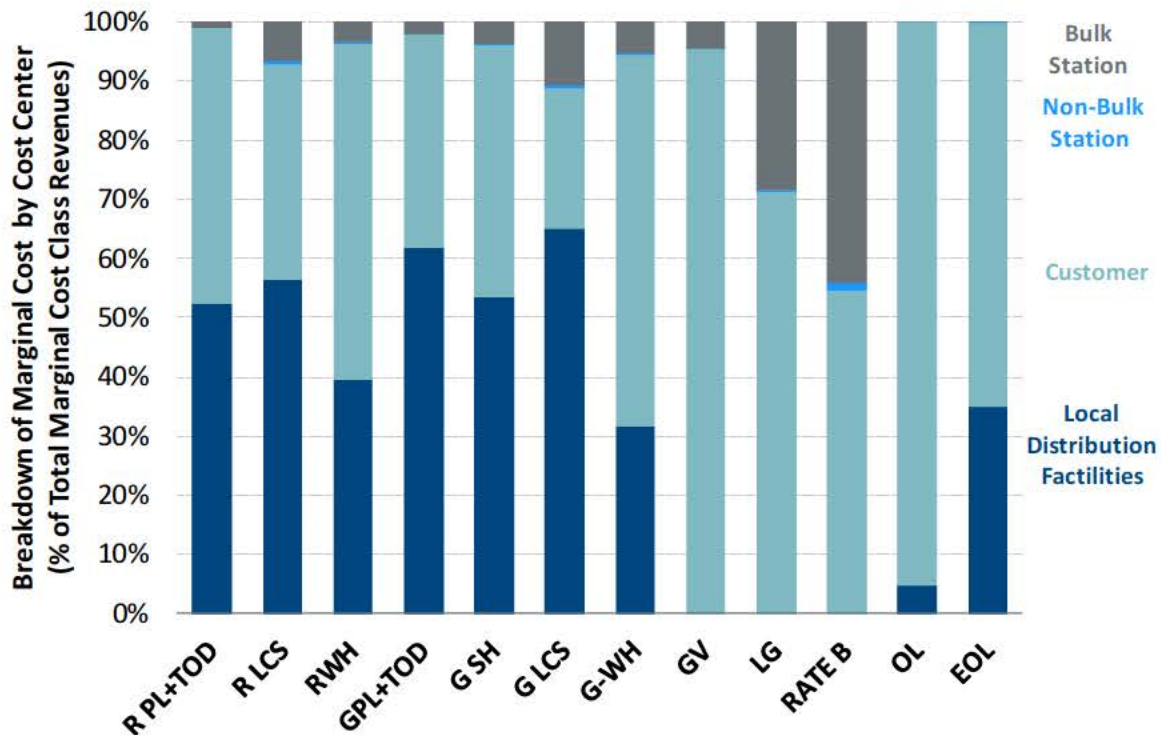

Source: Brattle calculation based on AJR Attachment-2 (Data Response Staff 14-002 Attachment).

A. PRIMARY DISTRIBUTION SYSTEM

Q. Please explain how the Eversource Study developed the unitized cost for the Bulk Station cost center.

A. The Study uses “project expectations” as per Eversource’s 5-year capital plan. From the 5-year capital plan, the Eversource Study included stations expected to be over 75% of current rating due to load growth based on a 90/10 forecast.³ The 90/10 forecast indicates that load is expected to exceed the forecast with less than 10% probability. The Eversource Study identifies [BEGIN CONFIDENTIAL] [END CONFIDENTIAL] investments that meet the criteria of loading over 75% of nameplate capacity by 2024.⁴

³ I understand that based upon the Staff testimony of Kurt Demmer, the Staff is addressing the appropriateness of the 75% loading criteria.


⁴ Confidential Attachment AJR-3 (Confidential OCA 2-51 Attachment E).

Redacted

1 **Q. Does the Eversource Study include all projects identified with anticipated usage**
2 **exceeding the 75% usage threshold for peak demand?**

3 A. No. [BEGIN CONFIDENTIAL] [REDACTED]
4 [REDACTED]
5 [REDACTED]
6 [REDACTED]
7 [REDACTED]
8 [REDACTED]
9 [REDACTED]
10 [REDACTED] [END CONFIDENTIAL]

11 **Figure 3: Eversource Bulk Station Overload**
12 **[BEGIN CONFIDENTIAL]**



13
14 **[END CONFIDENTIAL]**

15 *Sources and Notes:*

16 [2] – [5]: Confidential Attachment AJR-3 (Confidential OCA 2-51 Attachment E).

17 [6] = 75% × [5].

18 [7] = [4] / [5].

19 [8] = [4] – [6].

20 **Q. For the projects included, does the Study use the cost described in the capital**
21 **budget for each substation?**

Redacted

1 A. No. The costs used by the Study differ from those in the capital budget for two reported
2 reasons. First, for all projects, the total project costs included in the Study are lower
3 than those included in the capital budget, which is consistent with the concept that the
4 MCOS-related costs are a subset of the total project costs. Specifically, the Study
5 excludes investment costs that are related to substation reconfiguration or retirement of
6 obsolete equipment.⁵ This is a generally accepted practice and consistent with the
7 purpose of a marginal cost study. Second, the Eversource Study relies on estimates of
8 transformer replacement costs rather than budgeted project costs.⁶

9 While the total costs used within the Study are consistent with the capital budget, the
10 timing of the expenditures is not consistent for four stations. For these four stations
11 (Station 4, Station 6, Station 9, and Station 14), the Study includes *annual* expenditures
12 that exceed the capital budget *for that year*. As one example, the capital budget
13 indicates that expenditures on the [BEGIN CONFIDENTIAL] [REDACTED]
14 [REDACTED] [END CONFIDENTIAL] (Station 9) are not anticipated to begin until
15 2021.⁷ However, the annual expenditures used in the Eversource Study begin one year
16 earlier in 2020.⁸ Individual years where the annual expenditures included in the Study
17 exceed the capital budget for that year are shown in red in Figure 4.

⁵ Nieto Attachment MCOSS-1, Marginal Cost of Distribution Service Study and Implications for Rate Design; p. 8; Bates 001769.

⁶ Attachment AJR-4 (Data Response Staff 14-041).


⁷ Confidential Attachment AJR-5 (Confidential OCA 6-105 Attachment D).

⁸ Confidential Attachment AJR-6 (Confidential OCA 2-51 Attachment A).

Redacted

Figure 4: Comparison of MCOSS Bulk Station Project Spending with Eversource Five-Year Budget

[BEGIN CONFIDENTIAL]

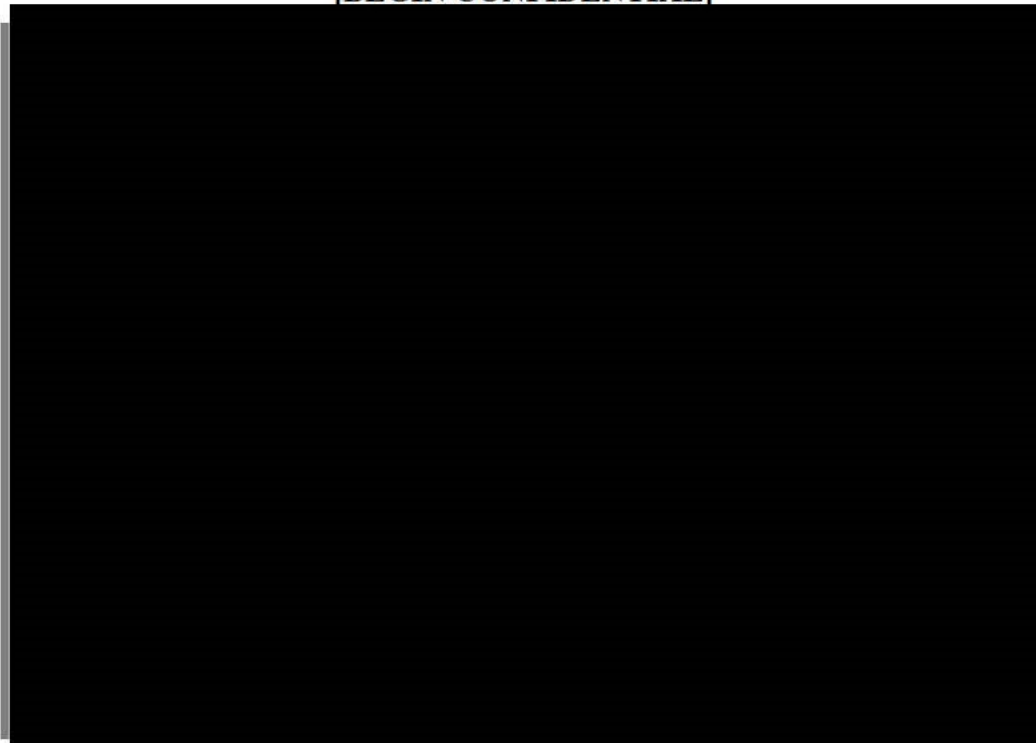

[END CONFIDENTIAL]

Source: Confidential Attachment AJR-5 (Confidential OCA 6-105 Attachment D) and Confidential Attachment AJR-6 (Confidential OCA 2-51 Attachment A).

Q. Can the mismatch in timing of expenditures between the annual expenditures in the capital budget affect the Study's results?

A. The timing of expenditures can influence the results in at least two different ways. First, the Study is in constant 2019 dollars, not nominal, meaning the costs are adjusted to account for inflation.⁹ A dollar invested in 2019 does not have the same value as a dollar invested in 2020 due to inflation. For example, if inflation was 2%, \$1 dollar in 2020 would be worth \$0.98 in 2019 constant dollars. Thus, the timing of investments has an impact on investments used in the Study.¹⁰

⁹ Attachment AJR-7 (Data Response Staff 14-040).

¹⁰ Witness Nieto's testimony does not explain why the \$2.5 million cost per transformer at the bulk station is unaffected by inflationary adjustments to calculate constant 2019 dollars.

1 Second, the timing of expenditures affects the present value of expenditures due to the
2 time value of money, commonly expressed, as “I’d rather have a dollar today than
3 tomorrow.” The present value calculation uses a discount rate that represents the time
4 value of money, which is often reflected in the utility’s weighted average cost of
5 capital. The Eversource Study’s approach does not discount the project costs to
6 determine a present value of costs, which would be influenced by the timing of the
7 expenditures.¹¹ In Section IV, I discuss the implications of these two points for the
8 Study.

9 **Q. Turning to the capacity portion of the Bulk Station MCOS calculation, how did**
10 **the Study determine the capacity to be used for each project?**

11 A. The Study calculated the total incremental capacity, meaning the total capacity added
12 to the bulk station adjusted by the 75% usage target.¹² For example, if an investment
13 added 10 MW of capacity, the total incremental capacity would be 7.5 MW.

14 **Q. With the project investment cost and project capacity, how did the Eversource**
15 **Study calculate the unitized cost?**

16 A. To calculate the unitized marginal cost, the Study divided the total project investment
17 costs by the incremental capacity of all projects. Collectively, the projects have a
18 capital expenditure of \$27.5M in 2019 inflation-adjusted dollars and an incremental
19 capacity of 151 MW, which results in a unitized cost of \$182.51 per kW. Figure 5
20 below shows unitized marginal costs for the bulk station category, both on a total basis
21 (i.e., including all investments), following the discussion above, and on a project-by-
22 project basis (i.e., project capacity divided by project capital expenditure).

23 To establish the system-wide unitized cost, the Study then applies two weighting
24 factors, the share of retail peak load served by the expanded stations over 2020-2024


¹¹ This is evidenced by the labeling of costs within the Eversource Study model, the calculation of the marginal costs (as demonstrated subsequently in Figure 5), and Witness Nieto’s response in Attachment AJR-7 (Data Response Staff 14-40).

¹² Nieto Attachment MCOSS-1; p. 8; Bates 001769.

Redacted

1 and the share of total retail distribution load fed from bulk stations, to yield the system-
2 wide Bulk Station marginal cost of \$36.33 per kW.¹³ This means that the bulk stations
3 that require capital expenditures over the next five years represent approximately 20%
4 of retail load.

5 **Figure 5: Bulk Station Unitized Cost Calculation**
6 **[BEGIN CONFIDENTIAL]**



7
8 **[END CONFIDENTIAL]**

9 *Sources and Notes:*

10 [2] - [3]: Confidential Attachment AJR-6 (Confidential OCA 2-51 Attachment A).

11 [4] = $75\% \times ([3] - [2])$. Total incremental capacity may not equal the sum of station
12 incremental capacity due to rounding.

13 [5]: Confidential Attachment AJR-6 (Confidential OCA 2-51 Attachment A). Costs are in
14 2019 dollars.

15 [6] = $[5] / [4]$. May not result in what is exactly shown in the column due to rounding.

16 [7] = $[6] \times 20.26\% \times 98.25\%$. 20.26% is the share of retail load served by the expanded
17 stations over 2020-2024, and 98.25% is the share of total retail distribution load fed from
18 bulk stations

19 **Q. Did the calculation of the Non-Bulk Station unitized cost follow the same approach**
20 **as the bulk unitized cost?**

21 A. For the most part, yes. Unlike the bulk projects, the investments included in the Non-
22 Bulk Station calculation were not determined based on forecasted loadings. Instead,
23 the Company estimated that three non-bulk capacity station expansions would be

¹³ Nieto Attachment MCOSS-1; pp. 9 and 21; Bates 001770 and 001782.

1 needed between 2022 and 2024.¹⁴ In lieu of specific project data, the Eversource Study
2 assumed (with consultation with the Company) that the projects would include
3 installation of three 12.5 MVA transformers to replace three existing transformers.¹⁵
4 The Study reported that the costs used for each project were the “typical costs” of
5 installing a 12.5 MVA substation transformer.¹⁶ The capacity for the substation
6 expansions were based on the incremental capacity provided by the 12.5 MVA
7 transformers, as shown in Figure 6. The incremental capacity is not adjusted by the
8 75% factor used for the bulk stations as the Company bases replacement on the
9 transformers long-term rating.¹⁷ The total cost divided by total incremental capacity
10 results in a Non-Bulk Station unitized value of \$250.60 per kW.

11 To establish the system-wide unitized cost, the Study again applies two weighting
12 factors, the share of retail peak load served by the expanded stations over 2020-2024
13 and the share of total retail distribution load fed from non-bulk stations, to yield the
14 system-wide Non-Bulk Station marginal cost of \$2.41 per kW.¹⁸

¹⁴ Attachment AJR-8 (Data Response Staff 14-007).

¹⁵ Specifically, Witness Nieto assumed that the transformers would replace two 5.25 MVA transformers and one 6.25 MVA transformer. Attachment AJR-8 (Data Response Staff 14-007).


¹⁶ Confidential Attachment AJR-9 (Confidential Data Response Staff 14-043).

¹⁷ Nieto Attachment MCOSS-1; p. 9; Bates 001770.

¹⁸ Nieto Attachment MCOSS-1; pp. 9 and 21; Bates 001770 and 001782.

Redacted

Figure 6: Non-Bulk Station Unitized Cost Calculation
[BEGIN CONFIDENTIAL]

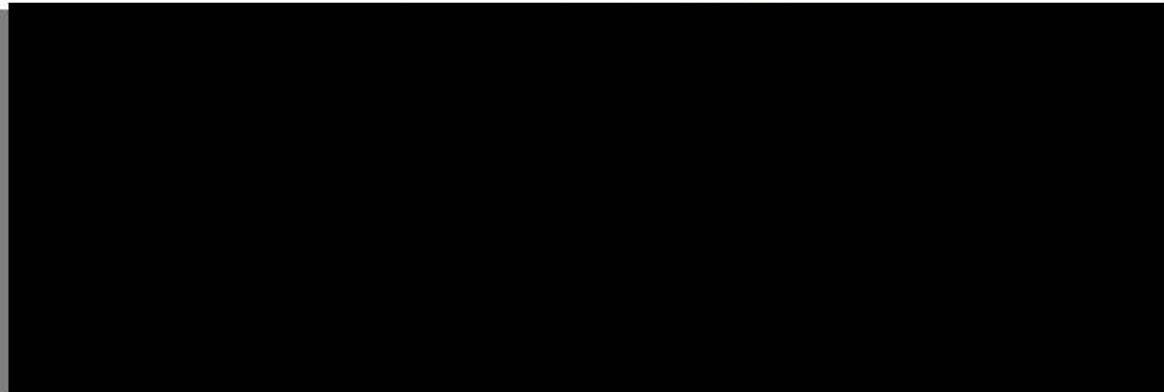

[END CONFIDENTIAL]

Sources and Notes:

[2] - [3]: Attachment AJR-8 (Data Response Staff 14-007).

[4] = [3] - [2].

[5]: Nieto Attachment MCOSS-1, Table A.2.2, Bates 001788. Costs reflect the typical costs of installing a 12.50 MVA transformer, and are in 2019 dollars. The MCOSS model provides the total cost of all three upgrades, and each project is assumed to cost the same amount.

[6] = [5] / [4]. MVA is assumed to be equivalent to MW. See Attachment AJR-10 (Data Response Staff 14-042), which discusses the conversion from MW to MVA for bulk station project incremental capacity.

[7] = [6] × 5.51% × 17.46%. 5.51% is the share of retail load served by the expanded stations over 2020-2024, and 17.46% is the share of total retail distribution load fed from non-bulk stations.

B. LOCAL DISTRIBUTION FACILITIES

Q. Is the Eversource Study's approach to the Local Distribution Facilities marginal cost similar to that for the primary cost centers?

A. No, the approach varies in two key ways. First, the Local Distribution Facilities calculation is based on design standards for customer types, which specifies the maximum load that the customer is expected to impose on the system.¹⁹ This means that the calculation is based on the cost associated with a customer's maximum design load rather than the customer's actual peak demand on the system. Thus, the approach adopted by the Study implies that the costs may not be avoided or reduced based on

¹⁹ Nieto Direct; p. 16, lines 14-17; Bates 001743.

1 usage.²⁰ The Study refers to this approach as the “rental value” of the average customer
2 in the class.²¹ Second, the Local Distribution Facilities calculation is based on a
3 historical sample of connection jobs rather than a going-forward anticipated cost.

4 **Q. Please describe the data used by the Eversource Study to calculate unitized cost**
5 **for Local Distribution Facilities.**

6 A. The Study uses a combination of a sample of historical estimates for customer
7 connection jobs to develop the costs and the design standards for capacity, as shown in
8 Figure 7. The Study used historical estimates of costs rather than actual costs on the
9 justification that up-front payment by the customer is based on the estimated cost of
10 the job rather than ultimate cost of completing the job.²²

11 **Figure 7: Local Distribution Facilities Work Order Summary**

Construction Type	Transformer	Number of Work Orders	Average Net Facilities Cost after CIAC (2019 \$)	Average Net Facilities Cost per kVA (2019 \$/kVA)
Single Phase Underground	Y	384	\$5,715	\$127
	N	273	\$2,122	n/a
Single Phase Overhead	Y	142	\$3,311	\$116
	N	91	\$2,587	n/a
Three Phase Underground	Y	63	\$7,318	\$141
	N	126	\$371	n/a
Three Phase Overhead	Y	22	\$10,408	\$221
	N	29	\$488	n/a

12 Source: Calculation Based on Attachment AJR-12 (OCA 7-14 Attachment, Replacement OCA
13 2-51 Attachment G) and Attachment AJR-13 (OCA 2-51 Attachment H). Costs are based on
14 estimated rather than actual costs.
15

16 **Q. How did the Study calculate the unitized cost from this sample?**

²⁰ Witness Nieto states this explicitly in her testimony: “The design demand that the Company considers when installing a transformer and local lines is the maximum load that the customers connected to those facilities are expected to impose on the local distribution system. This is distinctly different from the coincident peak demands that are considered when designing plant at the upstream voltage levels.” Nieto Direct; p. 16, lines 14-18; Bates 01743.

²¹ Nieto Direct; p. 16, lines 19-20; Bates 01743.

²² Attachment AJR-11 (Data Response Staff 14-036).

- A. The Eversource Study followed a five-step approach to calculate a unitized cost, the results of which are summarized in Figure 8:
1. Filters the sample of jobs to include only those with a transformer cost;
 2. For each remaining job, subtract contributions in aid of construction (i.e., customer contributions that reduce the utility's cost);
 3. For each remaining job, divide the net cost by the transformer capacity;
 4. Separate jobs into four categories based on the number of phases (single phase and three phase) and infrastructure type (overhead or underground), and calculate the average \$/kW costs for each of the four job types; and
 5. Calculate weighted averages of single phase and three phase jobs based on the relative shares of overhead and underground projects.

Figure 8: Unitized Local Distribution Facilities Cost per kVA

Single Phase		
<i>Underground</i>		
Average Net Facilities Cost per kVA	[A]	\$127
Average Share	[B]	21%
<i>Overhead</i>		
Average Net Facilities Cost per kVA	[C]	\$116
Average Share	[D]	79%
Single Phase Weighted Average Net Cost per kVA	[E]	\$118
Three Phase		
<i>Underground</i>		
Average Net Facilities Cost per kVA	[F]	\$141
Average Share	[G]	39%
<i>Overhead</i>		
Average Net Facilities Cost per kVA	[H]	\$221
Average Share	[I]	61%
Three Phase Weighted Average Net Cost per kVA	[J]	\$190

Sources and Notes:

[A] - [D]: Attachment AJR-12 (OCA 7-14 Attachment, Replacement OCA 2-51 Attachment G). All costs are in 2019 dollars.

$[E] = [A] \times [B] + [C] \times [D]$.

[F] - [H]: Attachment AJR-13 (OCA 2-51 Attachment H). All costs are in 2019 dollars.

$[J] = [F] \times [G] + [H] \times [I]$.

C. Marginal Customer Costs


- Q. What costs does the Eversource Study include in the cost center for Customer costs?

Redacted

A. The Study includes three different types of costs: meter costs, customer service drops, and customer account/customer expenses (i.e., costs associated with adding and maintaining a new customer account). The approach to quantifying the costs for the marginal customer differ between the cost centers. For metering, the Eversource Study relies on the “current installed cost” of typical meters by class, presumably from the Company.²³ Presumably, this is equivalent to the cost of a new meter going forward; however, the Study does not explicitly define the meter costs in this way.

The Eversource Study’s approach to creating a unitized per customer cost for service drops mirrors that used for the Local Distribution Facilities. The Eversource Study calculates the annual average customer service drop net cost (total cost minus customer contribution) for underground and overhead projects.²⁴ These average costs are weighted by shares of overhead and underground projects. This process is illustrated in Figure 9 for the R-P&L class.

Figure 9: Example of Service Drop Cost for R-P&L
[BEGIN CONFIDENTIAL]



[END CONFIDENTIAL]

Sources and Notes:

[A] - [D]: Confidential Attachment AJR-6 (Confidential OCA 2-51 Attachment A).

[E] = [A] × [C] + [B] × [D].

²³ Nieto Attachment MCOSS-1; p. 14; Bates 001775.

²⁴ The overhead and underground per customer after CIAC Service Drop Investment are hardcoded in the model (rows [A] and [B] in Figure 9), so it’s unclear exactly how these values are calculated.

1 Finally, for customer accounts/customer expenses, the Eversource Study relies on
2 2016-2018 FERC Form 1 cost data and 2018 customer counts. To calculate marginal
3 customer account-related expenses, the Eversource Study includes accounts: 901
4 (Supervision), 902 (Meter Reading Expenses), 903 (Customer Records and Collection
5 Expenses), and 904 (Uncollectible Accounts), 905 (Misc. Customer Accounts
6 Expenses). To allocate the FERC Form 1 costs to rate classes, the Eversource Study
7 uses a mix of historical data and other approaches.²⁵ Of these accounts, the majority of
8 costs arise from accounts 903 (67% of total) and 904 (24% of total). Similarly, for
9 customer service and informational expenses, the Eversource Study relies on 2014-
10 2018 FERC Form 1 cost data and 2018 customer counts. The marginal customer
11 service expenses include accounts: 907 (Supervision), 908 (Customer Assistance), 909
12 (Information & Instructional), and 910 (Misc. Customer Service & Info). Of the
13 accounts, only 908 and 910 are non-zero, with account 908 making up nearly 100% of
14 total costs.²⁶

15 In general, the Eversource Study builds up costs based on these accounts in the 2017
16 FERC data and then interpolates to produce an average value across 2014-2018. The
17 interpolation calculates a per residential meter cost in the years 2014 and 2018 and then
18 uses weightings to calculate rate specific costs. Rather than recreate analyses for 2014-
19 2016 and 2018, the Study calculates an “equivalent” number of residential meters,
20 called the “weighted number of customers,” for each rate class in 2017 based on the
21 2017 costs.²⁷ The Study then calculates the ratio between the annual number of
22 accounts and the sum of the “meter weighted” accounts. To calculate the per customer
23 costs in 2014-2016 and 2018, the Study divides the total customer account expenses by
24 the number of accounts, adjusted by the meter weighting. Because the accounts were

²⁵ Accounts 902 and 904 are allocated based on Company provided data. Account 903 has an unexplained hard-coded allocation. Account 905 is allocated evenly on a per customer basis. Account 901 is allocated proportionally based on the class-total share of costs in accounts 902-905.

²⁶ Account 908 is only allocated to Rate B classes based on class customer count. Account 910 is allocated evenly on a per customer basis.

²⁷ For example, if the cost per residential customer was equal to \$10 per customer and the cost per general service customer was equal to \$5 per customer, then two general service customers would be equivalent to one residential customer (\$10 divided by \$5).

1 normalized to reflect an equivalent cost, this division results in the cost per residential
2 accounts (assuming that the 2017 ratios of costs between the customer classes remains
3 constant.)

4 **D. OPERATIONS AND MAINTENANCE COSTS**

5 **Q. How were the O&M costs calculated within the Study?**

6 A. The O&M costs were calculated using average 2014-2018 historical FERC Form 1
7 data.²⁸ For the cost center specific FERC Form 1 accounts, relevant O&M expenses
8 were summed and then increased to reflect a share of O&M overhead amounts. These
9 O&M costs were then normalized per customer or kilowatt, inflated to constant dollars,
10 and averaged over the years of historical data. While this general approach was used
11 across cost centers, specific calculation details varied cost center to cost center. For
12 example, to calculate the O&M of Local Distribution Facilities, the Study first sums
13 relevant overhead and underground line maintenance accounts and then increases those
14 amounts based on a pro rata share of O&M overhead accounts. The share of these
15 O&M accounts was then multiplied by the percentage of primary and secondary lines
16 (relative to all circuit line miles) to assign the Local Distribution Facilities cost center
17 a pro rata share of the total relevant expenses.

18 The use of FERC Form 1 data for calculating marginal O&M expenses is a standard
19 and well-accepted approach in MCOS studies.

20 **E. DEVELOPMENT OF COSTING PERIODS FOR TIME DIFFERENTIATION**

21 **Q. How does time differentiation of rates tie into marginal costs?**

22 A. The costs of expanding the system can be allocated to certain time periods which are
23 driving the need for investment. Investment needs in the primary distribution system
24 are typically driven by peak demands (either local system, or system-wide). Identifying

²⁸ The O&M for stations, local distribution facilities, meters, and overhead include 13 FERC Form 1 accounts: 580, 582, 583, 584, 588, 590, 591, 592, 593, 594, 595, 597, and 598.

1 the time periods during which peaks occur allows costs to be allocated to these time
2 periods, which can be used to develop time of use or other rate structures.

3 To estimate the periods when peak would occur, the Study developed a “probability of
4 peak calculation.” The probability of peak approach adopted by the Study essentially
5 groups similar hours and considers the statistical likelihood that each group of hours
6 will produce the peak load. More specifically, [BEGIN CONFIDENTIAL] [REDACTED]

7 [REDACTED]
8 [REDACTED]
9 [REDACTED]
10 [REDACTED]
11 [REDACTED]
12 [REDACTED]
13 [REDACTED]
14 [REDACTED]
15 [REDACTED] [END CONFIDENTIAL]

16 IV. ANALYSIS

17 **Q. Based on your review of the Eversource Study’s analysis, do you have comments**
18 **on any of the methodological approaches adopted?**

19 A. Yes. I comment on two issues. The first has to do with the calculation of the Bulk and
20 Non-Bulk Station marginal investment costs, while the second involves the calculation
21 of the periods for time differentiation of the primary distribution system costs.

22 **Q. What are your comments on the calculation of the Bulk and Non-Bulk Station**
23 **marginal investment costs?**

1 A. The Eversource Study calculates the marginal investment costs of Bulk and Non-Bulk
2 Stations by taking the sum of the expected growth-related investment (in constant 2019
3 dollars) over the next 5 years and dividing it by the incremental capacity from these
4 investments. By calculating a straight sum of the investment costs for Bulk and Non-
5 Bulk Stations, regardless of the year of implementation, expenditures further out in the
6 future (say 2024) are weighted the same (in constant 2019 dollars) as expenditures in
7 2019. This approach is sometimes referred to as the Total Investment Method (“TIM”)
8 an approach with early support in the costing literature and that has been used in the
9 past by Commissions.³⁰

10 An alternative approach would take into account the time value of money and place
11 less weight on investments later in the period compared to 2019. The Discounted Total
12 Investment Method (“DTIM”) is one alternative approach recognized in the literature
13 and used in practice as well.³¹ The DTIM takes into account the *timing* of investments
14 over the planning horizon and by doing so places more weight in a marginal cost study
15 on those investments that are expected earlier in the period. The DTIM properly
16 discounts both the investments *and* the incremental capacity.³²

17 **Q. What reasons did Eversource give for not discounting the Bulk and Non-Bulk**
18 **Station investments?**

19 A. Eversource answered the following when asked why it did not discount investments:

20 *The marginal cost that the study aims to estimate is the incremental or*
21 *decremental cost associated with change in a unit of demand across the*
22 *entire five-year period. The study does not presume the year the particular*
23 *load change will take place. Thus, it does not seek to estimate the*

³⁰ See NARUC Manual, pp. 129-130, for a discussion on transmission marginal investment that applies a similar methodology as the Eversource Study. See also California Public Utilities Commission D.92-12-058 for a description of TIM for application in marginal gas transmission costs for revenue allocation.

³¹ This approach is also described in California Public Utilities Commission D.92-12-058.

³² The discounting of incremental capacity is justified by the very nature of capital—*i.e.*, the fact that the productive capacity of resources (*e.g.*, labor) embedded in capital is stored for use over the life of the equipment and is not expended concurrently with the provision of output. Mathematically, discounting the investments *and* the incremental capacity is required to prevent the marginal unit investment to tend to zero as the planning horizon increases.

1 *incremental (or avoided) cost that the Company would experience if the*
2 *load growth (or load reduction) took place in year 1 (2020) vs. year 2*
3 *(2021), etc. The MCOS study is designed to inform the ongoing marginal*
4 *cost impact through distribution rates, which will be fixed for the*
5 *foreseeable three or four years as opposed to being updated on an annual*
6 *basis. In addition, in practice, the timing for a particular planned*
7 *substations investment may shift by one year or more for reasons unrelated*
8 *to station load, such as changes in the pace of available funds, or other*
9 *reasons. In short, adopting a discounted cost approach would not add*
10 *accuracy to the marginal cost calculation due to the purpose of the MCOS*
11 *study coupled with the inherent uncertainty in the precise timing of the*
12 *distribution investment project over the five-year period.*³³

13 Thus, there appear to be two main reasons for not discounting: (1) the uncertainty in
14 timing of investment expenditures renders greater accuracy moot, and (2) because the
15 marginal costs are used to inform rates over a 3-4 year period, the marginal costs should
16 reflect a single marginal cost for the period.

17 **Q. Do you agree with these two premises?**

18 A. Neither are persuasive. Regarding the first, while I recognize the uncertainty in the
19 precise timing for distribution investments, I do not agree that this uncertainty negates
20 the value of using the best information available, *i.e.*, the Company's estimates of when
21 expenditures would be made. As I understand it, the best information available depicts
22 investments for the Bulk and Non-Bulk Stations occurring in different years during the
23 period and it is proper and appropriate to use that information in the MCOS Study.
24 Using the Company's estimates of expenditures would also negate the need to assume
25 that all investments should financially be treated as occurring in year one (2019) versus
26 any other year in the time horizon.

27 Regarding the second, I do not find the argument convincing. I do not see how the
28 issue of distribution rates being either fixed over three or four years or being updated
29 on an annual basis has a bearing as to whether to discount the investments in an MCOS
30 Study—in other words whether to use the TIM or DTIM. When multiplied by the real
31 economic carrying charge (RECC), both methodologies provide first year marginal

³³ Attachment AJR-7 (Data Response Staff 14-040).

1 annual costs that change each year based upon underlying inflation and technological
2 assumptions embedded in the RECC. The issue of how these first year costs will be
3 used in rate setting is separate from the issue of which methodology, TIM or DTIM, is
4 more or less sound.

5 **Q. Did you apply the DTIM methodology for the primary distribution system and**
6 **compare that to the Eversource methodology?**

7 A. Yes, the table below provides an estimate based, on high-level assumptions that would
8 need to be refined, of the impact on the Study's results when the Bulk and Non-Bulk
9 Station investments and incremental capacity are discounted. For the Bulk Station
10 calculation, I used the investment profile in the budget and for the Non-Bulk Station
11 calculation, I assumed that investments occurred during 2021-2024 and incremental
12 capacity coming on line in 2022, 2023, and 2024. Discounting investment and
13 incremental capacity under these assumptions—*i.e.*, implementing the DTIM
14 approach—in this particular case slightly increases marginal costs of the Bulk Station
15 investments on a \$/kW-year compared to not discounting and using the TIM. For the
16 Non-Bulk Station, there is practically no difference in the results.

17 **Figure 10: Impact of Discounting Bulk and Non-bulk Station Investments**

Methodology	Annualized System-Wide MC (\$/kW-yr)	
	Bulk Station	Non-Bulk Station
DTIM Approach <i>Using Discounted Project Costs and Capacity</i>	\$5.09	\$0.30
TIM Approach <i>Using Total Project Costs and Capacity</i>	\$4.94	\$0.30

18 *Sources and Notes:*

19 Annualized marginal costs from the TIM Approach are from Nieto Attachment MCOSS-1; p.
20 21; Bates 001782.

21 Annualized marginal costs from the DTIM Approach are calculated by discounting project costs
22 and incremental capacity using a 7.62% WACC from Quinlan Direct; p. 28, lines 6-8; Bates
23 000046.
24

25 **Q. What is your recommendation on this point?**

1 A. Although in this particular case the impact on the study will be relatively minor because
2 the Bulk Station MCOS are small overall compared to total MCOS results, I
3 recommend that the Study adopt the DTIM approach for calculating marginal capacity
4 costs for the Bulk Stations using the investment profile in the budget. In general, I
5 recommend future MCOS studies incorporate the DTIM approach as much as possible
6 given the availability of company information and data constraints.

7 **Q. Do you have comments on the time differentiation part of the Eversource Study**
8 **that is utilized in rate design?**

9 A. The approach taken by the Eversource Study to determine costing periods is
10 sophisticated and complex. Complexity certainly has a place where necessary, but I
11 believe it is appropriate to compare the Study's time differentiation results to results
12 from a more straightforward and more parsimonious methodology, of which there are
13 alternatives. As an example, a straightforward approach is to analyze and identify
14 historical load data that falls within 1%, 5%, or 10% of peak load and to examine where
15 those hour fall within a proposed rate design option. This approach is an example of a
16 deterministic method for time differentiation and is a generally accepted practice in a
17 marginal cost study.³⁴

18 **Q. Did you replicate the time differentiation analysis using a deterministic approach**
19 **that considers the number of hours that fall within a pre-defined percentage of**
20 **peak load?**

21 A. Yes, and the results show that the months of June and September are important months
22 as well, not just July and August.

23 **Q. Please explain your analysis.**

24 A. For each year, I calculated the number of hours that fall within 1%, 5% and 10% of that
25 year's peak hour—these are “critical hours” and the number of critical hours increase
26 as the threshold percentages increase, *i.e.*, going from 1% to 10%. I then matched the

³⁴ See Confidential Attachment AJR-15 (Confidential Data Response Staff 14-038)

1 critical hours to the different hour categories in Option A and Option B of the Study.
2 For example, there are three hour categories in Option A: the first hour category is July
3 and August Peak Hours, the second hour category is July and August Non-Peak Hours
4 and the third category is “all other hours.” By matching the critical hours to the
5 different hour categories in Option A and Option B, I was able to calculate the percent
6 of the critical hours that were contained in the different hour categories in Option A
7 and Option B.

8 Figure 11 below presents my results. Taking the 1% critical peak hours, under the
9 current TOU period, 100% of those critical hours fell within the year round peak period
10 and 0% fell outside the year round peak period. The Eversource Study concurs as it
11 found only a 1% probability of distribution peak occurring outside the year round peak
12 period. Thus, my analysis and the Eversource analysis match fairly well for the current
13 TOU periods.

14 With respect to Option A, however, my analysis found that 79% of the critical hours
15 using the 1% critical hours fell within the July and August Peak hours defined in Option
16 A, 0% fell within the July and August Off Peak hours, and 21% fell during the “all
17 other hours.” By contrast, the Eversource Study found only a 3% probability of
18 distribution peak occurring during those “all other hours.” When I increased the
19 number of critical peak hours—using the 5% and 10% threshold—I obtained similar
20 results; that is, I found a significant percentage of the “all other hours” containing those
21 critical hours.

Figure 11: Comparison of Distribution Substation Peak Probability Under Different TOU Period Definitions

Option and Period	Eversource Study Methodology	Alternate Methodology		
		1% Threshold	5% Threshold	10% Threshold
Current TOU Period				
Year-Round Peak	99%	100%	100%	99%
Year-Round Off Peak	1%	0%	0%	1%
Option A				
Summer (Jul & Aug) Peak	92%	79%	81%	73%
Summer (Jul & Aug) Off Peak	5%	0%	0%	8%
All Other Hours	3%	21%	19%	19%
Option B				
Summer (Jun-Sep) Peak	94%	100%	99%	90%
Summer (Jun-Sep) Off Peak	6%	0%	1%	10%
All Other Hours	0%	0%	0%	1%

Sources and Notes: The Current TOU Period defines Peak hours as 7am to 8pm on non-holiday weekdays, while Options A and B define Peak hours as 11am to 7pm on non-holiday weekdays. Option A defines Summer as July and August, while Option B defines Summer as June-September. Option and Period definitions are from Nieto Attachment MCOSS-1; pp. 10-11; Bates 001771-72.

Probability of peak under the Eversource Study Methodology are from Nieto Attachment MCOSS-1; pp. 29-30; Bates 001790-91. The Eversource methodology calculates the probability of distribution peak occurring within the hours in the rate design category. The alternative methodology calculates the percentage of hours in the rate design category (i.e., Summer Peak, Summer Off Peak and All Other Hours) that are within 1%, 5% and 10% of peak load.

What seems to be driving the difference between my analysis and the Eversource Study is the months of June and September. Option B of the Eversource Study defines the summer months as June-September. The Eversource Study shows a 0% probability of distribution peak occurring during the “all other hours” of Option B. My analysis is in agreement in that it shows that using the 1% and 5% critical peak hours, none of those hours are in the “all other hours”. When I increase the number of critical peak hours using the 10% threshold, I find that 1% are in the “all other hours,” still a very small amount.

The overall conclusion from my analysis is that hours in June and September are important hours of the year as well for purposes of time differentiation. Therefore, it is appropriate to consider the months of June and September in the definition of the

1 Summer Months for time differentiation purposes, and by implication, for rate design
2 analysis and associated tradeoffs.

3 **Q. Does this conclude your testimony?**

4 **A. Yes.**

Boston, MA

+1.617.864.7900

Agustin.Ros@brattle.com

Dr. Agustin J. Ros is a Principal of the Brattle Group whose expertise is in public utility economics and antitrust in network industries—airlines, energy, postal, telecommunications and water—and is an Adjunct Professor at the International Business School at Brandeis University where he teaches a course on public utilities and antitrust economics. He has more than 20 years of consulting and agency experience and specializes in cost of service and performance-based ratemaking, competition and market power in network industries, damages, and econometric modelling. He teaches at the annual Edison Electric Institute (“EEI”) Advanced Rate Course in Madison, Wisconsin on embedded and marginal cost of service as well as efficient rate design principles and practices. At the EEI Electric Rate Course he has taught industry professionals all aspects of embedded cost of service including the theory and practice of functionalization, classification, allocation and rate design.

Dr. Ros worked at the Illinois Commerce Commission where he reviewed dozens of cost of service studies and advised the Chairman on all matters before the Commission. His consulting and research interest includes examining the workings of retail electricity competition and his econometric and statistical investigation of competition in retail and wholesale electricity markets in the U.S. was recently published in the *Energy Journal*. In addition, he has published his research in the *Journal of Regulatory Economics*, *Review of Industrial Organization*, *Review of Network Economics*, *Telecommunications Policy* and *Info*.

AREAS OF EXPERTISE

- Cost of Service, Demand and Pricing in Network Industries
- Regulated Industry Policy and Restructuring
- Competition and Performance Based Ratemaking

EDUCATION

Ph.D. Economics, University of Illinois-Urbana Champaign	1994
M.S. Economics, University of Illinois-Urbana Champaign	1991
B.A. Economics, Rutgers University-Newark	1989

TEACHING POSITIONS

Brandeis University, International Business School, <i>Adjunct Professor</i>	2016–present
University of Anahuac, Mexico City, <i>Guest Lecturer</i>	2010
Northeastern University, <i>Adjunct Instructor</i>	2000

EXPERT REPORTS, TESTIMONY AND AFFIDAVITS

Testimony before the State of New Hampshire Public Utilities Commission, Docket No. DE 19-064, on behalf of the Staff of the New Hampshire Public Utility Commission on marginal cost of service studies, December 6, 2019.

Expert report on behalf of the Newfoundland and Labrador Board of Commissioners of Public Utilities: Review of Existing and Proposed Network Additions Policies for Newfoundland and Labrador Hydro, with Philip Hanser and Peal Donohoo-Vallet, November 19, 2019.

Expert report on behalf of Bragg Communications Inc. (c.o.b. Eastlink), Cogeco Communications Inc., Rogers Communications Canada Inc., Shaw Cablesystems G.P., and Videotron Ltd., Analysis of CRTC's Final Rates for Aggregated Wholesale High-Speed Access Services: Impact on Broadband Network Investment and Innovation, with Renée M. Duplantis, Dimitri Dimitropoulos and Ian Cass, November 13, 2019.

Testimony before the Virginia Corporation Commission, Case No. PUR-2019-00104, on behalf of the Virginia Electric Power Company on cost allocation of utility scale solar projects, July 1, 2019.

Expert report on behalf of the Newfoundland and Labrador Board of Commissioners of Public Utilities: Embedded and Marginal Cost of Service Review, with Phil Hanser, T. Bruce Tschusida, Pearl Donohoo-Vallet, and Lynn Zang, May 3, 2019.

Expert report on behalf of Shaw Communications before the Canadian Legislative Review Panel of the Broadcasting and Telecommunications: Analysis of BDU Contributions, ISP Taxes and Regulations in the Canadian Broadcasting and Telecommunications Industries: Economic Efficiency, Investment and Innovation, with Coleman Bazelon and Renée Duplantis, January 11, 2019.

Expert opinion on behalf of CFE International LLC before the U.S. Citizenship and Immigration Services and Department of Homeland Security: An Overview of the Mexican Energy Markets and Reforms, October 25, 2018.

Expert report on behalf of Shaw Communications before the Canadian Competition Bureau: An Analysis of Broadband Services in Canada, Competition, Regulation and Investment with Coleman Bazelon and Renée Duplantis, August 30, 2018.

Affidavit on behalf of CFE International LLC before the Federal Energy Regulatory Commission: market-based rate authority application on vertical and horizontal market power issues in U.S. electricity markets, with Judy Chang, June 13, 2018.

Expert report on behalf of the Australian Competition and Consumer Commission (ACCC), before the ACCC: International experiences in retail electricity markets, with Toby Brown, Neil Lessem, Serena Hesmondhalgh, James D. Reitzes and Haruna Fujita, June 2018

Expert report on behalf of Transportadora de Gas Natural de la Huasteca, S. de R.I. de C.V. before the Mexican Energy Regulatory Commission: expert opinion on issues related to the appropriate allowed rate of return for the TGNH pipeline, with Paul Carpenter and Bente Villadsen, May 23, 2018.

Expert report on behalf of Infraestructura Marina del Golfo, before the Mexican Energy Regulatory Commission: expert opinion on issues related to the appropriate allowed rate of return for the IMG pipeline, with Paul Carpenter and Bente Villadsen, May 23, 2018.

Expert report on behalf of GCI Communications before the Federal Communications Commission: rate of return, cost of service and cross-subsidy analysis of GCI's Satellite-Based Services, with William Zarakas and Nicolas E. Powers, May 2018.

Expert report on behalf of GCI Communications before the Federal Communications Commission, In the Matter of Connect America Fund and Universal Service Reform, WC Docket No. 10-90 and WT Docket No. 10-208A: analysis of the FCC's Rural Health Care Program Funding and Recipients, with William Zarakas, David Kwok, and M. Elaine Cunha, September 2017.

Expert report on behalf of Teléfonos de Mexico before the Mexican Telecommunications Authority: measurement of total factor productivity for Teléfonos de Mexico, July, 2014.

Expert report on behalf of Citibank, before the Honduran Competition Commission: expert report on the competitive effects of the FICHOSA – Citibank merger, April, 2014.

Expert report on behalf of America Móvil before the Mexican Competition Commission: correcting the OECD's erroneous assessment of competition in the Mexican telecommunications sector, May 2013. With Professor Jerry A. Hausman.

Expert report on behalf of Leyde and LACTHOSA before the Honduran Competition Commission: expert report on the competitive effects of a joint venture between Leyde and LACTHOSA in the Honduran dairy sector, April 2013.

Expert report on behalf of Lowe's Mexico before the Mexican Competition Commission: economic analysis on market definition, market power and monopolistic practices in the market for home improvement products sold through superstores, October 2012.

Expert report on behalf of Comcel before the Regulatory Commission of Communications in Colombia: expert report on economic analysis of Resolution CRC 3139 2011 regarding on-net and off-net pricing and termination rates, November 9, 2011.

Expert report on behalf of ESSOSA and Puma before the El Salvador Competition Commission: expert report on the competition implications of assets sales in El Salvador, (with Ramsey Shehadeh) October 5, 2011.

Expert report on behalf of ESSOSA and Puma before the Honduran Commission for the Defense and Promotion of Competition: expert report on the competition implications of assets sales in Honduras, (with Ramsey Shehadeh) July 19, 2011.

Testimony before the state of Illinois on behalf of Northern Illinois Gas Company, Docket No. 11-0046, surrebuttal testimony regarding market definition, market power and public interest considerations, filed April 22, 2011.

Testimony before the Alberta Public Utility Commission, Proceeding 566 Electricity Rate Regulation Initiative, update, reply and PBR review study, filed February 22, 2011.

Testimony before the Alberta Public Utility Commission, Proceeding 566 Electricity Rate Regulation Initiative, total factor productivity study, filed December 30, 2010.

Testimony before the state of Illinois on behalf of Northern Illinois Gas Company, Docket No. 09-0310, rebuttal testimony regarding market definition, market power and public interest considerations, filed August 6, 2010.

Expert report before the Commission for the Supervision of Business Competition of the Republic of Indonesia on behalf of Singapore Telecommunications Limited and Singapore Telecom Mobile, "Competitive Assessment of the Indonesian Mobile Sector," (with William E. Taylor, Nigel Attenborough and Christian Dippon), filed October 15, 2007, rebuttal report filed January 11, 2008.

Expert report before the Ministry of Economic Affairs and Development on behalf of Cable and Wireless Barbados, "An Economic Assessment of Mandating Indirect Access in Barbados," (with Michael Khyefets and Loren Adler), November 14, 2007.

Expert report before the Supervising Agency for Private Investment in Telecommunications in Peru (OSITPEL) on behalf of Telefonica de Peru, expert report on economic efficiency considerations with respect to termination rates and the impact of capacity-based charges, (with Jose Maria Rodriguez), filed October 17, 2007.

Expert report before the Canadian Radio and Telecommunications Commission (Telecom Public Notice CRTC 2006-14) on behalf of Bell Aliant Regional Communications, "Telecommunications Competition in the US: An Assessment of Wholesale Regulation Policy," (with William E. Taylor), filed March 15, 2007.

Expert report before the New York Public Service Commission (Case 06-C-0897) on behalf of Verizon New York, “Report on Competition for Retail Business Services,” (with William E. Taylor and Harold Ware), filed report August 31, 2006. Supplemental Report filed October 2, 2006.

Expert report before the Telecommunications Authority of Trinidad and Tobago on behalf of Telecommunications Services of Trinidad and Tobago, response to Digicel’s economic analysis of Interconnections costs and rates, filed May 12, 2006 (with Timothy Tardiff).

Expert report before the Telecommunications Authority of Trinidad and Tobago on behalf of Telecommunications Services of Trinidad and Tobago, expert report on interconnections costs in Trinidad and Tobago, filed May 4, 2006 (with Timothy Tardiff).

Expert report before the Telecommunications Authority of Trinidad and Tobago on behalf of Telecommunications Services of Trinidad and Tobago, expert report on Benchmark Mobile Termination Rates, Evaluation of the .Econ Report, filed February 10, 2006 (with Timothy Tardiff).

Expert report before the Supervising Agency for Private Investment in Telecommunications in Peru (OSITPEL) on behalf of Telefonica de Peru, expert report on OSITPEL’s imputation methodology, filed February 7, 2006 (with Jose Maria Rodriguez and Eduardo Prieto Kessler).

Expert report before the Comisión Federal de Telecomunicaciones de México, on behalf of Telcel, S.A., expert report measuring the cost Telcel incurs when providing interconnection services to operators, filed 22 June 2005.

Expert report before the Supervising Agency for Private Investment in Telecommunications in Peru (OSITPEL) on behalf of Telefonica de Peru, final report regarding the estimation of Telefonica de Peru’s total factor productivity for application in the 2004-2007 price cap regime (with José María Rodríguez Ovejero and Juan Hernández García), 21 June 2004.

Expert report before the Bahamas Public Utilities Commission, on behalf of the Bahamas Telecommunications Company, “Public Consultation on the Universal Service Obligation in The Bahamas,” Comments filed 24 March 2004; Reply Comments filed 10 June 2004.

Expert report before the Canadian Radio-television and Telecommunications Commission on behalf of Aliant Telecom Inc., Bell Canada, MTS Communications Inc., Saskatchewan Telecommunications and Télébec, société en commandite, Public Notice 2003-10, “A Review of Rules and Regulations Governing Bundled Telecommunications Services.” filed 12 March 2004, updated report filed 26 March 2004.

Expert report before the Bahamas Public Utilities Commission, on behalf of the Bahamas Telecommunications Company, “Public Consultation on Price Control of Bahamas Telecommunications Company,” 19 September 2003.

Expert report before the Comisión Federal de Telecomunicaciones de México, on behalf of the Commission, “Telmex’s 2003-2006 Price Cap Tariff Proposal,” expert report in arbitration regarding the renewal of the price cap plan for Telmex (with William Taylor, Georgina Martinez, and Aniruddha Banerjee), 13 December 2002.

Expert report before the Honorable Arbitration Tribunal of Fairness in Guatemala, Case No. CENAC-A-01-2002, final report in arbitration regarding call termination costs in fixed and wireless networks (with José María Rodríguez Ovejero, Laurent Bensancon, and Juan Hernández García), September 2002.

Expert report before the Federal Communications Commission on behalf of BellSouth Corporation Docket Nos. 01-338, 96-98, 98-47 Reply Declaration (with William Taylor, Aniruddha Banerjee, and Charles Zarkadas) regarding unbundling obligations of local exchange carriers. Filed 17 July 2002.

Expert report before the Federal Communications Commission on behalf of Verizon Communications, Docket Nos. 01-339, 01-337, 02-33, Statement of 43 Economists on the Proper Regulatory Treatment of Broadband Internet Access Service, 3 May 2002.

Expert report before the New Zealand Commerce Commission on behalf of Telecom New Zealand, “Review of CostQuests’ Associates Benchmarking Survey” (with William Taylor, Greg Houston, Tom Hird, Jaime D’Almeida, and Carol Osborne), May 2002.

Testimony before the State of Illinois on behalf of Verizon North Inc. and Verizon South Inc., Docket No. 98-0195, surrebuttal testimony regarding investigation into certain payphone issues as directed in Docket 97-0225, 16 July 2001.

Expert report before the Supervising Agency for Private Investment in Telecommunications in Peru (OSIPTEL) on behalf of Telefonica de Peru, final report regarding the estimation of Telefonica de Peru’s total factor productivity for application in the 2001-2003 price cap regime (with Timothy Tardiff, José María Rodríguez Ovejero, and Juan Hernández García), 22 June 2001.

Testimony before the State of Illinois on behalf of Verizon North Inc. and Verizon South Inc., Docket No. 98-0195, rebuttal testimony regarding investigation into certain payphone issues as directed in Docket 97-0225, 20 April 2001.

Expert report before the New Zealand Commerce Commission, on behalf of Telecom New Zealand, “Costs of Telecommunications Competition Policies,” final report exploring the indirect economic costs of changing competition policy to a more regulatory approach (with Harold Ware, Timothy Tardiff, and Nigel Attenborough), May 2000.

Testimony before the State of Illinois on behalf of GTE North Incorporated and GTE South Incorporated, Docket No. 98-0195, direct testimony regarding investigation into certain payphone issues as directed in Docket No. 97-0225, 21 December 1999.

Expert report before the Federal Communications Commission on behalf of US West, An Economic and Policy Analysis of Efficient Inter-Carrier Compensation Mechanisms for ISP-Bound Traffic, 12 November 1999.

Expert report before the Pennsylvania Public Utility Commission on behalf of Bell Atlantic Pennsylvania, Promised Fulfilled: Bell Atlantic-Pennsylvania's Infrastructure Development (with William Taylor, Charles Zarkadas, and Jaime D'Almeida), 15 January 1999.

Testimony before the State of Illinois on behalf of Illinois Gas Transmission Company, Docket No 98-0510, rebuttal testimony regarding certification of Illinois Gas Transmission Company as a Common Carrier by Pipeline and approval of rates and accounting, and for cancellation of the Certificate of Illini Carrier, LP, 11 January 1999.

Expert report before the Spanish Regulatory Commission on behalf of Telefónica, final report "Assessment of the methodology used by Telefónica in the calculation of the prices included in the interconnection reference offer and comparison with BT's interconnection prices" (with Nigel Attenborough, David Robinson, Yogesh Sharma, and José María Rodríguez Ovejero), October 1998.

Expert report before the Italian Regulatory Commission on behalf of Telecom Italia, final report "Volume Discounts: A Report for Telecom Italia" (with Nigel Attenborough, Andrea Coscelli, and Andrea Lofaro), October 1998.

Expert report before the Federal Communications Commission on behalf of Bell Atlantic, Docket Nos. 96-262, 94-1, 91-213, 96-263, "An Analysis of the Effects of Exchange Access Reform on Demand Stimulation" (with Charles Zarkadas), 27 April 1997.

RECENT CONSULTING ENGAGEMENTS

Consulting work on behalf of a major electricity distribution company in the U.S.: cost study and competitive pricing principles of advanced metering services. 2018.

Consulting work on behalf of a Canadian electricity provider: benchmarking analysis of generation utilities in transmission and regulatory practices with respect to generation procurement practices, distributed energy resources and customer-specific pricing practices, 2018.

Consulting work on behalf of a U.S. generation and transmission electricity cooperative: embedded and marginal cost of service studies to support rate reform initiative, 2018.

Consulting work on behalf of a major electricity distribution provider in the U.S.: develop a locational distribution marginal cost-based cost of service study to support the value of distributed energy resource proceedings, 2017 - 2018.

Consulting report on behalf of major foreign electricity and gas distribution company: Rules and regulations applicable to the competitive U.S. retail electricity providers in the U.S. and Canada: A regulatory assessment. November 2017.

Consulting report on behalf of major foreign electricity and gas distribution company: Rules and regulations applicable to the competitive U.S. retail natural gas providers in the U.S. and Canada: A regulatory assessment. November 2017.

Consulting work on behalf of the Cities of Garland, Mesquite, Plano, and Richardson appealing the decision by North Texas Municipal Water District affecting wholesale water rates, Texas PUC Docket No. 46662 and SOAH Docket No. 473-17-4964.WS: economic analysis of whether wholesale water rate charged by the District adversely affects the public interest and rate design issues.

Consulting work on behalf of a major electricity distribution company in the U.S.: cost study and competitive pricing principles of advanced metering services. 2015 - 2016.

Consulting report for the Mexican National Center for the Control of Natural Gas: Electricity demand forecast for the National Mexican Electricity System for the period 2017-2030. December 2016. With Veronica Irastorza and Elvira Creel.

Consulting report for the Mexican Secretariat of Communications and Transport: “Econometric demand study of fixed and mobile broadband and telephony services and Pay-TV services using discrete choice analysis.” January 2016. With Kenneth Train and Douglas Umaña.

Consulting report for the Mexican Secretariat of Energy, CFE horizontal generation split analysis: recommended number of CFE gencos. September 2015. With Hamish Fraser and Willis Geffert.

Consulting report for the Mexican Secretariat of Energy, CFE horizontal generation split analysis: Recommended optimal portfolio mix for the CFE gencos. September 2015. With Hamish Fraser and Willis Geffert.

Consulting report for the Mexican Secretariat of Energy, CFE horizontal generation split analysis: Identification of relevant markets within the Mexican wholesale electricity markets. August 2015. With Hamish Fraser and Willis Geffert.

Consulting report for the Mexican Secretariat of Energy: Vesting contract criteria and methodology report. July 2015. With Hamish Fraser, Gene Meehan and Kurt Strunk.

RECENT PRESENTATIONS

Presentation before Rutgers University’s Center for Research in Regulated Industries, Advanced Workshop: “Residential Electricity Competition at a Crossroads,” January 2019.

Presentation before the EEI Electric Rates Advanced Course, “Introduction to Embedded Cost of Service,” with Phil Q Hanser, July 2018.

Presentation before the EEI Electric Rates Advanced Course, “Introduction to Marginal Cost of Service,” with Phil Q Hanser, July 2018.

Presentation before the Public Collaborative for the Puerto Rico Electricity System, “Introduction to Utility Regulation,” with Karl McDermott, July 19, 2018.

Presentations before the Public Collaborative for the Puerto Rico Electricity System, “Introduction to Electricity System Planning,” with Karl McDermott, July 19, 2018.

Presentation before the Public Collaborative for the Puerto Rico Electricity System, “Ownership Structure, Contracting Process and Wholesale Markets,” with Karl McDermott, July 19, 2018.

Presentation before Rutgers University Center for Research in Regulated Industries Eastern Conference: “Marginal cost of service: electricity distribution locational marginal costs, with Phillip Q Hanser and T. Bruce Tsuchida, June 8, 2018.

Presentation before the World Forum on Energy Regulation, Cancun Mexico: “Rate design helping facilitate change in electricity markets,” March 2018.

Presentation before Rutgers University’s Center for Research in Regulated Industries, Advanced Workshop: “Utility of the future and cost of service: challenges and opportunities,” January 2018.

Presentation before Rutgers University’s Center for Research in Regulated Industries, 36th Annual Eastern Conference: “The evolving electricity distribution network – technological, competitive and regulatory implications.” May 2017.

Presentation before Rutgers University’s Center for Research in Regulated Industries, Advanced Workshop: “Costing and pricing of electricity smart grid service offerings and competitive implications.” January 2017.

Presentation before Rutgers University’s Center for Research in Regulated Industries, 35th Annual Eastern Conference: “Determinants of total factor productivity in the U.S. electricity sector and the effects of performance-based regulation.” May 2016.

Presentation before Rutgers University’s Center for Research in Regulated Industries, Advanced Workshop: “merger theory and practice in the U.S. electricity sector.” January 2016.

PUBLICATIONS

“Economic framework for compensating distributed energy resources: Theory and practice.” (with Romkaew Broehm and Philip Hanser), *The Electricity Journal* 31(8): 14-22 (2018).

“The future of the electric grid and its regulation: Some considerations,” *The Electricity Journal* 31(2): 18-25 (2018).

“An Econometric Assessment of Electricity Demand in the United States using Utility-Specific Panel Data and the Impact of Retail Competition on Prices.” *The Energy Journal* 38(4): 73-99 (2017).

“An Econometric Assessment of Telecommunications Prices and Consumer Surplus in Mexico using Panel Data.” (with Jerry A. Hausman), *Journal of Regulatory Economics*, vol. 43:284-304 (2013).

“Corrección de la Evaluación Errónea de la OCDE Acerca de la Competencia en el Sector de las telecomunicaciones en México.” (con Jerry Hausman), *El Trimestre Económico* (2013).

“The Impact of Asymmetric Mobile Regulation in Colombia.” (with Douglas Umana), *Info*, vol. 15 No. 3:54-65 (2013).

“Correcting the OECD’s Erroneous Assessment of Telecommunications Competition in Mexico.” (with Jerry A. Hausman), *CPI Antitrust Chronicle* June 2012.

“North American Performance-Based Regulation for the 21st Century.” (with Jeff D. Makholm and Stephen Collins), *Electricity Journal* vol. 25, Issue 4, May 2012.

“The Determinants of Pricing in the Mexican Domestic Airline Sector: The Impact of Competition and Airport Congestion.” *Review of Industrial Organization* vol. 38:1 (2011), pp 43-60.

“Anticipating Merger Guidelines from Mexico’s Commission on Competition.” (with Elizabeth M. Bailey), *International Antitrust Bulletin* vol. 4, (2010).

“X-factor Updating and Total Factor Productivity Growth: The Case of Peruvian Telecommunications, 1996-2003.” (with Jeffrey I. Bernstein, Juan Hernandez and Jose Maria Rodriguez), *Journal of Regulatory Economics*, vol. 30:3 (2006), pp 316-342.

“Crecimiento de la demanda por servicios de comunicación móviles. Mitos y realidades (International Mobile Demand Growth: Myths and Reality)” (with Aniruddha Banerjee), *AHCIET Móvil* (September 2005).

“Concepto de costes básicos para la modelización entelecomunicaciones (Basic Economic Cost Concepts for Telecommunications Cost Modeling), Perspectivas en Telecomunicaciones (Perspectives in Telecommunications) (July 2005).

“Drivers of Demand Growth for Mobile Telecommunications Services: Evidence from International Panel Data.” (with Aniruddha Banerjee), in *Global Economy and Digital Society*, Elsevier (2004).

“Patterns in Global Fixed and Mobile Telecommunications Development: A Cluster Analysis.” (with Aniruddha Banerjee), *Telecommunications Policy*, vol. 28 (2004), pp. 107-132.

“The Impact of the Regulatory Process and Price Cap Regulation in Latin American Telecommunications Markets.” *Review of Network Economics*, vol. 2 (2003), pp. 270-286.

“Does Employee Ownership Motivate Workers? Worker Effort, Shirking and Horizontal Monitoring in ESOP.” The Determinants of the Incidence and the Effects of Participatory Organizations, *Advances in the Economic Analysis of Participatory and Labor Management*, edited by Takao Kato and Jeffrey Pliskin, Elsevier Science, vol. 7 (2003).

“The Internet: Market Characteristics and Regulatory Conundrums.” (with Aniruddha Banerjee), *Forecasting the Internet: Understanding the Explosive Growth of Data Communications*, edited by David G. Loomis and Lester D. Taylor, Kluwer Academic Publishers (2002), pp. 187-216.

Profits for All? The Costs and Benefits of Employee Ownership, Nova Science Publishers, (2001).

“Are Residential Local Exchange Prices Too Low? Drivers to Competition in the Local Exchange Market and the Impact of Inefficient Prices.” (with Karl McDermott), in *Expanding Competition in Regulated Industries*, edited by Michael Crew, Kluwer Academic Publishers (2000), pp. 149-168.

“Telecommunications Privatization and Tariff Rebalancing: Evidence from Latin America.” (with Aniruddha Banerjee), *Telecommunications Policy*, vol. 24 (2000), 233-252.

“Utility Regulation in Latin America.” (with Leonardo Giacchino, Cesar Herrera, Siôn Jones, Phillip Maggs, and Kristina Sepetys), *Privatisation International*, edited by Mark Baker, vol. 2 (2000).

“Essential Facilities, Economic Efficiency, and a Mandate to Share: A Policy Primer.” (with Karl McDermott, Kenneth Gordon, and William Taylor), Edison Electric Institute (January 2000).

“Does Ownership or Competition Matter? The Effects of Telecommunications Reform on Network Expansion and Efficiency.” *Journal of Regulatory Economics*, vol.15 (1999), pp. 65-92.

“Telecommunication Restructuring in Brazil: Issues and Options (A Report Based on the Proceedings of the U.S./Brazil Aspen Global Forum).” International Center for Public Administration and Policy Institute for Policy Research and Implementation, Graduate School of Public Affairs, University of Colorado at Denver (December 1997).

“When, Where and How? Implementing Effective Telecommunications Competition & Regulatory Policy.” *Journal of Project Finance* (Winter 1997).

“Telecommunications in Brazil: Restructuring and Privatization” (et. al.), A Report Based on the Proceedings of the Brazil/U.S. Aspen Global Forum, International Center for Public Administration and Policy Institute for Policy Research and Implementation, Graduate School of Public Affairs, University of Colorado at Denver, August (1997).

“Another Look at What’s Driving Utility Stock Prices.” (with John L. Damagalski and Philip R. O’Connor), *Public Utilities Fortnightly* (January 1997).

"Regulatory Change and the Dismantling of the Bottleneck." Tenth NARUC Biennial Regulatory Information Proceedings (October 1996).

"Stranded Costs: Is the Market Paying Attention? A Look at Market-to-Book Ratios." (with John L. Damagalski and Philip R. O'Connor), *Public Utilities Fortnightly* (May 1996).

"The Gas Storage Market: What Does it Tell Us?" (with Ruth Kretschmer), *Public Utilities Fortnightly* (April 1996).

"Incentive Ratemaking in Illinois: The Transition to Competitive Markets" (with Terry S. Harvill), *Public Utilities Fortnightly* (July 1995).

Public Service of New Hampshire d/b/a Eversource Energy
Docket No. DE 19-057

Date Request Received: 10/11/2019

Date of Response: 10/25/2019

Request No. STAFF 14-002

Page 1 of 1

Request from: New Hampshire Public Utilities Commission Staff

Witness: Edward A. Davis, Amparo Nieto

Request:

Reference Amparo Nieto testimony. Provide the annual marginal cost based revenue requirement by cost center (i.e., bulk station, non-bulk station, primary trunk, local distribution, and customer cost) for a customer using the design demand and average usage. Provide this example in a live Excel format.

Response:

Please see Attachment Staff 14-002 for the Marginal Cost-of-Service Study by component.

MCOS-BASED REVENUE BY CLASS

TEST YEAR 2018
(\$ Thousands)

	6/30/2018													
BREAKDOWN OF MCOSS BY COMPONENT	TOTAL RETAIL	R PL+TOD	R LCS	RWH	GPL+TOD	G SH	G LCS	G-WH	GV	LG	RATE B	OL	EOL	
Bulk distribution stations	4,305.52	1,634.69	19.1	56.4	993.5	2.0	2.6	2.3	955.7	631.5	7.6	0.1	0.1	
Distribution non-bulk substations	\$183	97.9	1.1	3.4	59.5	0.1	0.2	0.1	17.2	3.2	0.3	0.0	0.1	
Distribution Primary feeder	\$0	-	-	-	-	-	-	-	-	-	-	-	-	
Local distribution facilities (Transf. & local conductors)	\$120,938	89,018.0	161.9	624.8	30,932.2	28.5	16.1	13.4	-	-	-	78.2	65.0	
Customer MC	\$121,796	78,849.9	104.5	902.3	18,011.9	22.7	5.8	26.6	20,563.5	1,583.8	9.4	1,594.0	121.7	
Total MCOS Results by Rate Class (before reconciling)	247,222.70	169,600.5	286.7	1,586.8	49,997.0	53.2	24.7	42.5	21,536.4	2,218.5	17.2	1,672.3	186.8	

Note: Calculated using hourly kWh by Class times Hourly Marginal Costs (distribution bulk and non-bulk substations) and with design demand (Dis Facilities)

	R PL+TOD	R LCS	RWH	GPL+TOD	G SH	G LCS	G-WH	GV	LG	RATE B	OL	EOL
Annual Class kWh used in computation of Bulk, and Non Bulk Sub MC	3,144,970,835	36,776,885	92,916,119	1,716,678,138	5,451,861	4,509,879	3,379,300	1,665,675,827	1,135,836,018	18,134,626	17,848,655	12,455,893
Design kW used in computation of Distribution Facilities Cost	11.63	2.54	0.83	21.28	4.06	4.77	0.63	-	-	-	4.46	3.71
Average Marginal Cost (cent/kWh) by Cost Center												
Bulk distribution stations	0.0519779	0.0519779	0.0606959	0.0578742	0.0360479	0.0578742	0.0672078	0.0573738	0.0556013	0.0417527	0.0006185	0.0005882
Distribution stations	0.0031121	0.0031121	0.0036340	0.0034651	0.0021583	0.0034651	0.0040239	0.0010305	0.0002778	0.0013826	0.0000370	0.0005882
Distribution Primary feeder	-	-	-	-	-	-	-	-	-	-	-	-
Local distribution facilities (Transf. & local conductors)	2.8304889	0.4402960	0.6724213	1.8018608	0.5224704	0.3565511	0.3975410	0.0000000	0.0000000	0.0000000	0.4381502	0.5216290
Average Marginal cost per kWh	2.8855788	0.4953859	0.7367512	1.8632001	0.5606766	0.4178904	0.4687727	0.0584044	0.0558792	0.0431353	0.4388057	0.5228054

[REDACTED]

Public Service of New Hampshire d/b/a Eversource Energy
Docket No. DE 19-057

Date Request Received: 10/11/2019

Date of Response: 10/25/2019

Request No. STAFF 14-041

Page 1 of 1

Request from: New Hampshire Public Utilities Commission Staff

Witness: Edward A. Davis, Amparo Nieto

Request:

Refer to con_19-057_res_oca_6_105_d_att_eversource.xlsx (confidential), tab "Substation Reliability," and con_19-057_res_oca_2_51_a_att_eversource.xlsx (confidential), tab "Capital Budget Bulk Stat W2."

- a. Please confirm that the projects in rows 15-17 and 20-21 of the Eversource Capital Budget are included in the Eversource MCOSS Model.
- b. Please explain the following discrepancies between the projects listed in the Capital Budget vs. in the MCOSS Model:
 1. Huse Rd.: The MCOSS (in row 10) reports 2020 costs of \$1M, while the Capital Budget (in row 20) reports no costs in 2020.
 2. Monadnock: The MCOSS (in row 12) reports 2019 costs of \$1M, while the Capital Budget (row 16) reports 2019 costs of \$500K.
 3. Madbury: The MCOSS (row 13) reports 2021 costs of \$1M, while the Capital Budget (row 21) reports no costs in 2020.
- c. Please explain why the Long Hill project included in the MCOSS (row 14), but not part of the Capital Budget.

Response:

- a) That is correct.
- b) The total project cost per transformer was estimated at \$2.5m. The replacement of a transformer typically requires engineering, site work, protection upgrades and other commissioning costs. We broke down the \$2.5 m so that about 20 percent of the cost would take place the year before the transformer would become operative, and 80 percent the year the transformer would be operative. In other words, the full replacement work for each transformer is assumed to be completed over two years. This split is mainly cosmetic and does not affect the resulting marginal cost estimate since, as explained in answer to Question 14-40, no discounted cost approach was used.
- c) The Capital Budget includes a Long Hill project, in line 23, which incorrectly states "Pine Hill" in the version that the Staff received. A correction was made by the Company to replace Pine Hill with "Long Hill" in the budget file on April 2019. This revision was noted by the MCOS study but did not get to the version of the Excel file that was submitted as part of the back-up documentation.

Project Overview										Financial Summary										Operational Metrics									
Project Details					Timeline					Budget					Actuals					Performance					Efficiency				
ID	Name	Status	Manager	Start Date	End Date	Duration	Budget	Actual	Variance	Progress %	Completion %	Quality Score	Customer Sat.	Team Size	Resources	Cost	Revenue	Profit	ROI	Efficiency	Productivity	Quality	Customer	Team	Resources	Cost	Revenue	Profit	ROI
P001	Project Alpha	Completed	J. Doe	2023-01-01	2023-03-31	90	\$100,000	\$95,000	\$5,000	100%	100%	95	4.5	10	5	\$100,000	\$120,000	\$20,000	20%	85%	90%	95%	4.5	10	5	\$100,000	\$120,000	\$20,000	20%
P002	Project Beta	In Progress	A. Smith	2023-02-01	2023-05-31	120	\$150,000	\$140,000	\$10,000	80%	75%	90	4.2	12	6	\$150,000	\$160,000	\$10,000	7%	80%	85%	90%	4.2	12	6	\$150,000	\$160,000	\$10,000	7%
P003	Project Gamma	On Hold	M. Johnson	2023-03-01	2023-06-30	120	\$80,000	\$80,000	\$0	50%	40%	88	4.0	8	4	\$80,000	\$80,000	\$0	0%	75%	80%	85%	4.0	8	4	\$80,000	\$80,000	\$0	0%
P004	Project Delta	Planned	S. Lee	2023-04-01	2023-07-31	120	\$120,000	\$120,000	\$0	10%	5%	82	3.8	6	3	\$120,000	\$120,000	\$0	0%	60%	70%	75%	3.8	6	3	\$120,000	\$120,000	\$0	0%
P005	Project Epsilon	Completed	K. Brown	2023-01-15	2023-04-15	90	\$90,000	\$88,000	\$2,000	100%	100%	92	4.3	9	4	\$90,000	\$105,000	\$15,000	17%	88%	92%	95%	4.3	9	4	\$90,000	\$105,000	\$15,000	17%
P006	Project Zeta	In Progress	L. White	2023-02-15	2023-05-15	90	\$110,000	\$105,000	\$5,000	70%	65%	89	4.1	11	5	\$110,000	\$115,000	\$5,000	5%	78%	82%	88%	4.1	11	5	\$110,000	\$115,000	\$5,000	5%
P007	Project Eta	On Hold	N. Green	2023-03-15	2023-06-15	90	\$70,000	\$70,000	\$0	40%	30%	86	3.9	7	3	\$70,000	\$70,000	\$0	0%	70%	75%	80%	3.9	7	3	\$70,000	\$70,000	\$0	0%
P008	Project Theta	Planned	O. Black	2023-04-15	2023-07-15	90	\$130,000	\$130,000	\$0	5%	2%	80	3.7	5	2	\$130,000	\$130,000	\$0	0%	55%	65%	70%	3.7	5	2	\$130,000	\$130,000	\$0	0%
P009	Project Iota	Completed	P. Grey	2023-01-20	2023-04-20	90	\$85,000	\$83,000	\$2,000	100%	100%	91	4.4	8	3	\$85,000	\$100,000	\$15,000	18%	87%	91%	94%	4.4	8	3	\$85,000	\$100,000	\$15,000	18%
P010	Project Kappa	In Progress	Q. Blue	2023-02-20	2023-05-20	90	\$105,000	\$100,000	\$5,000	65%	60%	87	4.0	10	4	\$105,000	\$110,000	\$5,000	5%	75%	80%	85%	4.0	10	4	\$105,000	\$110,000	\$5,000	5%

CCONFIDENTIAL Attachment OCA 2-051A

Page 1 of 6

	2019		2020	
	Actual	Target	Actual	Target
Operating income	1,000	1,000	1,000	1,000
Operating expenses	800	800	800	800
Operating profit	200	200	200	200
Non-operating income	0	0	0	0
Non-operating expenses	0	0	0	0
Non-operating profit	0	0	0	0
Income before taxes	200	200	200	200
Income taxes	50	50	50	50
Net income	150	150	150	150
Net income per share	1.50	1.50	1.50	1.50

CONFIDENTIAL Attachment OCA 2-051A

	2019	2020
1. Revenue	100%	100%
2. Operating Expenses	85%	85%
3. Operating Income	15%	15%
4. Non-Operating Expenses	5%	5%
5. Non-Operating Income	0%	0%
6. Income Before Taxes	10%	10%
7. Income Tax Expense	3%	3%
8. Net Income	7%	7%

**PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE
D/B/A, EVERSOURCE ENERGY
BACK-UP CALCULATION OF BULK DISTRIBUTION SUBSTATIONS - CAPACITY-EXPANSION INVESTMENT (2020 - 2024)**

Figure 1 is a Gantt chart illustrating the construction schedule for the 1000 MW Boreas Wind Farm. The chart shows the duration of various construction activities from 2010 to 2014. The activities are categorized into three main groups: Foundation and Access Road Construction, Tower and Nacelle Installation, and Wind Farm Commissioning. The chart shows that the construction period spans from late 2010 to early 2014, with significant overlap between different activities. The total construction period is approximately 3 years and 6 months.

Activity	Start Date	End Date
Foundation and Access Road Construction	2010-12-01	2013-01-01
Tower and Nacelle Installation	2011-01-01	2013-06-01
Wind Farm Commissioning	2013-01-01	2014-03-01

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29

PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE
D/B/A, EVERSOURCE ENERGY
BACK-UP CALCULATION OF BULK DISTRIBUTION SUBSTATIONS - CAPACITY-EXPANSION INVESTMENT (2020 - 2024)

The chart displays capacity expansion investments for various bulk distribution substations from 2020 to 2024. The y-axis represents capacity in MW, ranging from 0 to 15. The x-axis represents years from 2020 to 2024. The legend indicates that blue bars represent 'Investment', green bars represent 'Capacity', and red bars represent 'Substation'. The chart shows that capacity expansion investments are concentrated in the years 2020, 2021, and 2022, with significant increases in capacity for several substations. The substations are labeled as follows: 1. 1. 2. 3. 4. 5. 6. 7. 8. 9. 10. 11. 12. 13. 14. 15. 16. 17. 18. 19. 20. 21. 22. 23. 24. 25. 26. 27. 28. 29.

PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE
D/B/A, EVERSOURCE ENERGY
BACK-UP CALCULATION OF NON-BULK DISTRIBUTION SUBSTATIONS - CAPACITY EXPANSION INVESTMENT (2020-2024)

Page 6 of 6

Public Service of New Hampshire d/b/a Eversource Energy
Docket No. DE 19-057

Date Request Received: 10/11/2019

Date of Response: 10/25/2019

Request No. STAFF 14-040

Page 1 of 1

Request from: New Hampshire Public Utilities Commission Staff

Witness: Edward A. Davis, Amparo Nieto

Request:

Refer to Nieto testimony, Bates 001769, "To compute the marginal cost of bulk and distribution stations we divided the identified peak-load related station investment by station's project added capacity."

- a. Please confirm that the peak-load related station investments are in constant dollars.
- b. Please confirm that the marginal cost calculation does not discount the investments and thereby weighs a \$1 investment made in 2020 the same as a \$1 investment made in 2021, 2022, 2023, and 2024.
- c. If the answer to b is yes, please explain why investments should not be discounted for marginal cost calculations.

Response:

- a) Yes, all dollars of investment are stated already in 2019 dollars.
- b) The marginal cost calculation takes inflation into account. Thereby \$1 of investment in year 2021 is assumed to be $\$1/(1+\text{inflation})$ in year 2019.
- c) The marginal cost that the study aims to estimate is the incremental or decremental cost associated with change in a unit of demand across the entire five-year period. The study does not presume the year the particular load change will take place. Thus, it does not seek to estimate the incremental (or avoided) cost that the Company would experience if the load growth (or load reduction) took place in year 1 (2020) vs. year 2 (2021), etc. The MCOS study is designed to inform the ongoing marginal cost impact through distribution rates, which will be fixed for the foreseeable three or four years as opposed to being updated on an annual basis. In addition, in practice, the timing for a particular planned substations investment may shift by one year or more for reasons unrelated to station load, such as changes in the pace of available funds, or other reasons. In short, adopting a discounted cost approach would not add accuracy to the marginal cost calculation due to the purpose of the MCOS study coupled with the inherent uncertainty in the precise timing of the distribution investment project over the five-year period.

Redacted

Docket No. DE 19-057
Data Request Staff 14-043
Dated 10/11/19
Attachment Staff 14-043
Page 1 of 1

Staff 14-043 Confidential Response

[Redacted]

[Redacted]

[Redacted]

[Redacted]

Public Service of New Hampshire d/b/a Eversource Energy
Docket No. DE 19-057

Date Request Received: 10/11/2019

Date of Response: 10/25/2019

Request No. STAFF 14-007

Page 1 of 1

Request from: New Hampshire Public Utilities Commission Staff

Witness: Edward A. Davis, Amparo Nieto

Request:

Refer to MCOSS Study Report (Att. MCOSS-1), Bates 001768-69: "The 2019 MCOS utilizes project expectations as per the Company's capital plan over years 2020-2024...." Please identify non-bulk projects in the Eversource Capital Budget that are included in the MCOSS.

Response:

The Company's five-year capital plan at the time of conducting the MCOS study anticipated three non-bulk capacity expansion stations in years 2022 through 2024. These investments are noted in Confidential Attachment OCA 6-105 under tab "Substation Peak" and under the line item "Substation Peak Load Project". The Company has not formalized the specific investment and therefore cost detail was not available. However, recognizing that some peak load investment will take place, the MCOS study assumed, upon consultation with the Company, that this project will at least involve installation of three 12.5 MVA transformers, replacing three existing transformers (two of 5.25 MVA and one 6.25 MVA).

Staff 14-043 Confidential Response

[Redacted]

[Redacted]

[Redacted]

[Redacted]

Public Service of New Hampshire d/b/a Eversource Energy
Docket No. DE 19-057

Date Request Received: 10/11/2019

Date of Response: 10/25/2019

Request No. STAFF 14-042

Page 1 of 1

Request from: New Hampshire Public Utilities Commission Staff

Witness: Edward A. Davis, Amparo Nieto

Request:

Refer to confidential con_19-057_res_oca_2_51_a_att_eversource.xlsx, tab "Capital Budget Bulk Stat W2."

- a. Refer to total costs in 2019 \$ (col K):
 1. Explain why project costs are not discounted.
 2. Explain why 2019 project costs included in the total costs.
- b. Refer to Project added load carrying capability in MVA (col AD):
 1. Explain why the incremental load carrying capability used in the cost unitization calculation reflect the total incremental capability of the project, rather than the incremental capability needed to meet load growth.
 2. Explain why the conversion from MW to MVA not involve power factors.

Response:

a)

1. Please see response to 14-040.
2. The Company anticipated that a share of the costs of the substation projects that will be in service by end of 2020 and 2021 would be incurred in 2019. Construction of these transformers is scheduled to begin in 2020, only a small amount of engineering costs has been incurred in 2019 to date. The MCOS study needs to capture the full cost of each transformer upgrade in order to be representative of the typical marginal cost associated with growth of bulk station-coincident peak demand.

b)

1. The substation transformer comes in standard sizes and transformer investment has economies of scale, meaning the per unit cost of larger transformer is lower than the per-unit cost of smaller transformer. Using the added load-carrying capability of the transformer as opposed to just the kW of capacity needed to solve the constraint over the next five years smooths out the lumpiness effect of the substation investment and at the same time allows the study to capture the economies of scale.
2. The Company applies power factor correction measures to ensure that the power factor approaches unity at the low side of the transformer before considering other mitigation measures, therefore 1 MW is assumed to be equal to 1 MVA.

Public Service of New Hampshire d/b/a Eversource Energy
Docket No. DE 19-057

Date Request Received: 10/11/2019

Date of Response: 10/25/2019

Request No. STAFF 14-036

Page 1 of 1

Request from: New Hampshire Public Utilities Commission Staff

Witness: Edward A. Davis, Amparo Nieto

Request:

Refer to 19-057_res_oqa_7_14_att_(REPLACEMENT 051-G).eversource.xlsx, tab "Summary."

- a. In column D, why is the average net facilities cost based on estimated costs, rather than actual costs?
- b. In column F, what is the source of the average OH/UG split?

Response:

- a) The calculation of typical connection costs by class that would need to be recovered in rates produces a more realistic number when relying on the estimated net facilities costs because the up-front payment by the customer is based on the estimated cost of the job rather than ultimate cost of completing the job. There are situations when the job cost estimate may be higher or lower than the ultimate connect costs. In those cases the customer up-front payment is higher or lower than the customer contribution that would have been requested ex-post.
- b) Information on existing breakdown of underground vs overhead transformers was provided by the Company. Please see Attachment Staff 14-037 for the source of the OH/UG split.

**Average Single-Phase Facilities Costs in 2019 Dollars
Overhead and Underground, 2015 - 2017**

(Rounded to standard design)

Construction Type	Include Transformer?	Average Gross Facilities Cost per kVA (2019\$)	Average Net Facilities Cost (after CIAC) per KVA (2019\$)	Average OH/UG split	Average Transformer Cost per kVA (2019\$)	Average Transformer Size per Work Order (kVA)	Median Transformer Size (KVA)	Average Transformer Size (kVA)	No. of Residential customers per transformer 1-ph	Average kVA per Customer (residential)	No. of GS 1-ph Customers per Transformer	Average kVA per Customer (GS)
UG 1 PH	Y	\$174.04	\$126.77	0.21	\$100.29	46.1	37.5	50	2.6	19.23	1.55	32.26
OH 1 PH	Y	\$191.79	\$115.98	0.79	\$64.78	29.4	25.0	25	2.6	9.62	1.55	16.13
Average Cost (after CIAC)			\$118.24						Weighted Average kVA (1-ph)	11.63	Weighted Average kVA (1-ph)	19.52

Service Drop Drop	2019\$ Gross \$/ft	2019\$ Net \$/ft
OH	11.85	11.76
UG	10.82	11.76

**Average Three-Phase Facilities Costs in 2019 Dollars
Overhead and Underground, 2015 - 2017**

Construction Type	Include Transformer?	Average Gross Facilities Cost per kVA (2019\$)	Average Net Facilities Cost (after CIAC) per KVA (2019\$)	Average OH/UG split	Average Transformer Cost per kVA (2019\$)	Median Transformer Size (KVA)	Max Size (KVA)	No. of customers per transformer GS-3ph	kVA per GS Customer
UG	Y	\$168.87	\$141.26	0.39	\$80.77	50.0	175.0	1.9	26.32
OH	Y	\$229.67	\$220.91	0.61	\$84.49	50.0	150.0	1.9	26.32
Average Cost (after CIAC)				\$189.85				Weighted Average kVA (3-ph)	\$26.32 kVA

[illegible]

[illegible][illegible]

Case No.	Case Name	Case Address	Case City	Case State	Case Zip	Case Phone	Case Email	Case Fax	Case Web	Case Notes	Case Status	Case Date	Case Time	Case User	Case Role	Case Org	Case Dept	Case Div	Case Sect	Case Sub	Case Item	Case Qty	Case Price	Case Total	Case Tax	Case Ship	Case Ins	Case Ref	Case Ref2	Case Ref3	Case Ref4	Case Ref5	Case Ref6	Case Ref7	Case Ref8	Case Ref9	Case Ref10	Case Ref11	Case Ref12	Case Ref13	Case Ref14	Case Ref15	Case Ref16	Case Ref17	Case Ref18	Case Ref19	Case Ref20	Case Ref21	Case Ref22	Case Ref23	Case Ref24	Case Ref25	Case Ref26	Case Ref27	Case Ref28	Case Ref29	Case Ref30	Case Ref31	Case Ref32	Case Ref33	Case Ref34	Case Ref35	Case Ref36	Case Ref37	Case Ref38	Case Ref39	Case Ref40	Case Ref41	Case Ref42	Case Ref43	Case Ref44	Case Ref45	Case Ref46	Case Ref47	Case Ref48	Case Ref49	Case Ref50	Case Ref51	Case Ref52	Case Ref53	Case Ref54	Case Ref55	Case Ref56	Case Ref57	Case Ref58	Case Ref59	Case Ref60	Case Ref61	Case Ref62	Case Ref63	Case Ref64	Case Ref65	Case Ref66	Case Ref67	Case Ref68	Case Ref69	Case Ref70	Case Ref71	Case Ref72	Case Ref73	Case Ref74	Case Ref75	Case Ref76	Case Ref77	Case Ref78	Case Ref79	Case Ref80	Case Ref81	Case Ref82	Case Ref83	Case Ref84	Case Ref85	Case Ref86	Case Ref87	Case Ref88	Case Ref89	Case Ref90	Case Ref91	Case Ref92	Case Ref93	Case Ref94	Case Ref95	Case Ref96	Case Ref97	Case Ref98	Case Ref99	Case Ref100
1	Case 1	Case 1 Address	Case 1 City	Case 1 State	Case 1 Zip	Case 1 Phone	Case 1 Email	Case 1 Fax	Case 1 Web	Case 1 Notes	Case 1 Status	Case 1 Date	Case 1 Time	Case 1 User	Case 1 Role	Case 1 Org	Case 1 Dept	Case 1 Div	Case 1 Sect	Case 1 Sub	Case 1 Item	Case 1 Qty	Case 1 Price	Case 1 Total	Case 1 Tax	Case 1 Ship	Case 1 Ins	Case 1 Ref	Case 1 Ref2	Case 1 Ref3	Case 1 Ref4	Case 1 Ref5	Case 1 Ref6	Case 1 Ref7	Case 1 Ref8	Case 1 Ref9	Case 1 Ref10	Case 1 Ref11	Case 1 Ref12	Case 1 Ref13	Case 1 Ref14	Case 1 Ref15	Case 1 Ref16	Case 1 Ref17	Case 1 Ref18	Case 1 Ref19	Case 1 Ref20	Case 1 Ref21	Case 1 Ref22	Case 1 Ref23	Case 1 Ref24	Case 1 Ref25	Case 1 Ref26	Case 1 Ref27	Case 1 Ref28	Case 1 Ref29	Case 1 Ref30	Case 1 Ref31	Case 1 Ref32	Case 1 Ref33	Case 1 Ref34	Case 1 Ref35	Case 1 Ref36	Case 1 Ref37	Case 1 Ref38	Case 1 Ref39	Case 1 Ref40	Case 1 Ref41	Case 1 Ref42	Case 1 Ref43	Case 1 Ref44	Case 1 Ref45	Case 1 Ref46	Case 1 Ref47	Case 1 Ref48	Case 1 Ref49	Case 1 Ref50	Case 1 Ref51	Case 1 Ref52	Case 1 Ref53	Case 1 Ref54	Case 1 Ref55	Case 1 Ref56	Case 1 Ref57	Case 1 Ref58	Case 1 Ref59	Case 1 Ref60	Case 1 Ref61	Case 1 Ref62	Case 1 Ref63	Case 1 Ref64	Case 1 Ref65	Case 1 Ref66	Case 1 Ref67	Case 1 Ref68	Case 1 Ref69	Case 1 Ref70	Case 1 Ref71	Case 1 Ref72	Case 1 Ref73	Case 1 Ref74	Case 1 Ref75	Case 1 Ref76	Case 1 Ref77	Case 1 Ref78	Case 1 Ref79	Case 1 Ref80	Case 1 Ref81	Case 1 Ref82	Case 1 Ref83	Case 1 Ref84	Case 1 Ref85	Case 1 Ref86	Case 1 Ref87	Case 1 Ref88	Case 1 Ref89	Case 1 Ref90	Case 1 Ref91	Case 1 Ref92	Case 1 Ref93	Case 1 Ref94	Case 1 Ref95	Case 1 Ref96	Case 1 Ref97	Case 1 Ref98	Case 1 Ref99	Case 1 Ref100

[illegible][illegible][illegible]

[illegible]

[illegible]

Public Service of New Hampshire d/b/a Eversource Energy
Docket No. DE 19-057

Date Request Received: 10/11/2019

Date of Response: 10/25/2019

Request No. STAFF 14-038

Page 1 of 1

Request from: New Hampshire Public Utilities Commission Staff

Witness: Edward A. Davis, Amparo Nieto

Request:

Refer to Nieto testimony on time differentiation, Bates 001771, "The MCOS uses hourly probability of peak factors for each typical weekday and weekend by month to allocate the annual marginal bulk station and non-bulk station costs to hours and months."

- a. Please describe in detail the methodology used to develop the probability of peak factors.
- b. Please refer to other instances where Ms. Nieto has used the same methodology.
- c. Please provide citations to the costing literature for support of the methodology.

Response:

Please see Confidential Attachment Staff 14-038 for the response.

Pursuant to Puc 203.08(d) and RSA 363:28, VI, Eversource provides this response on a confidential basis to the Commission Staff and the Office of Consumer Advocate. Eversource submits that it has a good faith basis for seeking confidential treatment of the documents in this response and that it intends to submit a motion for confidential treatment of the documents prior to the commencement of any hearing in this proceeding.

Redacted

Docket No. DE 19-057
Data Request Staff 14-038
Dated 10/11/19
Attachment Staff 14-038
Page 1 of 1

Staff 14-038

Confidential Response

[Redacted]

[Redacted]

[Redacted]

[Redacted]

[Redacted]

[Redacted]

[Redacted]