

NH Public Utilities Commission

REC Aggregator Portal

New Users [CLICK HERE](#) to setup your account for this form. Creating an account enables you to partially complete the form and return later to finish it or to make changes after the form is submitted. Be sure to create your account BEFORE entering information into the form, or the information will be lost.

Existing Users [CLICK HERE](#)

Basic Information

Who is submitting this request?

Aggregator

Aggregator Batch Number

KE060916

Are you registered in NH

- Yes
- No

Aggregator name

Knollwood Energy

NH Reg #

Aggregator Email

karenton@knollwoodenergy.com

Other Aggregator name

Other aggregator email address

Facility Name

Facility Owner Name

Kathy Taris

Facility Owner email

kmtaris@gmail.com

Owner Phone

603-508-2782

Facility Address

19 May Lane

Facility Town/City

Pelham

Facility State

NH

Facility Zip

03076

Is the facility address the same as the owner's mailing address

- Yes
 No

Mailing Address

Mailing Town/City

Mailing State

Mailing Zip

Primary Contact

Karen Tenneson

Primary Contact

Facility Primary Contact

karenton@knollwoodenergy.com

Other Email Address

Facility Information

Class

Utility

Other Utility Name

To obtain a GIS ID contact:

James Webb

408 517 2174

jwebb@apx.com

GIS ID (include "NON")

Date of Initial Operation

Facility Operator Name, if applicable

Panel Make #1

Panel Model

Panel Quantity

Panel Rated Output

Other panel make

Other panel model

More Panel types?

- No
 Yes

Panel Make #2

Panel Model

Panel Quantity

Panel Rated Output

More Panel types?

- No
 Yes

Panel Make #3

Panel Model

Panel Quantity

Panel Rated Output

System capacity based on panels

Inverter Make

Other inverter make

Inverter Quantity

24

Add'l Inverter Quantity

NA

Additional Inverter Make

None

Rated Output - Primary Inverter

280

Rated Output - Additional Inverter

System capacity based on single inverter make

6720

System capacity based on two inverter types

System capacity in kW as stated on the interconnection agreement

6.72

Revenue Grade Meter Make

Revenue Grade GIS Approved Meter

HIALEAH

Other revenue-grade GIS-approved meter

Was this facility installed directly by the customer (no electrician involved)?

- Yes
 No

Electrician Name & Number

Troy Diamond 12218M

Other Electrician Name & Number

Installation Company

Granite State Solar

Other Installation Company Name

Other Inst. Company Address

Other Inst. Company City

Other Inst. Company State

Other Inst. Company Zip

Equipment Vendor Company Name

Independent Monitor Name & Company

Paul Button - Energy Audits Unlimited

Other Monitor Name and Company

Is the installer also the equipment supplier?

- Yes
 No

Equipment Vendor

Please attach your completed interconnection agreement including Exhibit B.

https://fs30.formsite.com/jan1947/files/f-5-99-6969568_NYeUFTtw_taris_ex_b_complete.pdf

The project described in this application will meet the metering requirements of PUC 2506 including:

Electricity generation in megawatt hours shall be reported to the GIS quarterly with a statement that the submission is accurate by the owner of the source, the independent monitor or a designated representative.

A revenue quality meter (meeting ANSI C-12.1-2008 for installations up to and including 10 kW, or ANSI C12.16 or better for installations greater than 10kW up to 1 mW) is used to measure the electricity generated.

The facility owner has certified to the independent monitor that the meter operates according to manufacturing standards.

The meter shall be maintained according to the manufacturer's recommendations.

The project is installed and operating in conformance with applicable building codes.

A copy of the facility's interconnection agreement is attached.

Please attach additional document here

https://fs30.formsite.com/jan1947/files/f-5-168-6969568_iUdMzxcy_Taris_NHOS.pdf

Please attach additional document here

https://fs30.formsite.com/jan1947/files/f-5-173-6969568_PwIBj0UK_taris_intercon_signedSPIA.pdf

Aggregator statement of accuracy

Sign your name using a mouse or, if you are using a touch-screen device, a stylus or other pointer.



Print Name

Karen Tonnesen

Date Signed

06/09/2016


Exhibit B - Certificate of Completion for Simplified Process Interconnections

Installation Information:

Check if owner-installed

Customer or Company Name (print): Kathy Taris		Contact Person, if Company:	
Mailing Address: 19 May Ln			
City: Pelham	State: NH	Zip Code: 03076	E-Mail Address kmtaris@gmail.com
Telephone (Daytime): (603) 508-2782	(Evening):	Facsimile Number:	
Address of Facility (if different from above):			
City:	State:	Zip Code:	
Generation Vendor: Granite State Solar	Contact Person: Justin Thomas		

I hereby certify that the system hardware is in compliance with Puc 900.

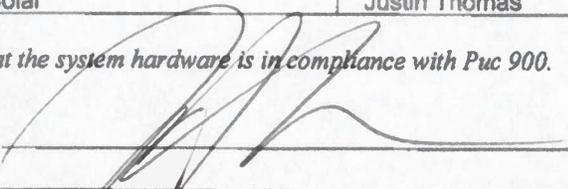Vendor Signature:  Date: 5/16/16

Electrical Contractor's Name (if appropriate): Granite State Solar		License number: 0366 C	
Mailing Address:			
City: Boscawen	State: NH	Zip Code: 03303	E-Mail Address justin@granitestatesolar.com
Telephone (Daytime): (603) 369-4318	(Evening):	Facsimile Number:	

Date of approval to install Facility granted by the Company: 2/26/16 Installation Date: 5/10/16
Application ID number: 2015-167

Inspection:

The system has been installed and inspected in compliance with the local Building/Electrical Code of

PELHAM N.H. 03076 Hillsborough
(City/County)

Signed (Local Electrical Wiring Inspector, or attach signed electrical inspection): 

Name (printed): TIM ZELONIS Date: 5-16-16

Dated: July 03, 2012
Effective: July 03, 2012

Issued by: /s/ Victor D. Del Vecchio
Victor D. Del Vecchio
Title: President

Authorized by Docket No. DG 11-040, NHPUC Order No 25,370, Dated 05/30/2012

Customer Certification:

I hereby certify that, to the best of my knowledge, all the information contained in this Interconnection Notice is true and correct. This system has been installed and shall be operated in compliance with applicable electrical standards. Also, the initial startup test required by Puc 905.04 has been successfully completed.

Customer Signature: Sally O'Brien Date: 9/23/15

As a condition of interconnection you are required to send/fax a copy of this form to:

Director of Engineering
Distribution Engineering Dept.
Liberty Utilities
11 Northeastern Blvd.
Salem, NH 03079
Fax No.: 603 896 6175

Dated: July 03, 2012
Effective: July 03, 2012

Issued by: /s/ Victor D. Del Vecchio
Victor D. Del Vecchio
Title: President

New Hampshire PUC REC Certification Application Owner Statements

The information provided on this application for New Hampshire Renewable Energy Certificate eligibility is accurate to the best of my knowledge and I authorize Knollwood Energy to act on my behalf in filing said application.

The project described in this application will meet the metering requirements of PUC 2506 including:

Electricity generation in megawatt hours shall be reported to the GIS quarterly with a statement that the submission is accurate by the owner of the source, the independent monitor, or a designated representative.

A revenue quality meter is used to measure the electricity generated.


The facility owner has certified to the independent monitor that the meter operates according to manufacturing standards.

The meter shall be maintained according to the manufacturer's recommendations.

The project is installed and operating in conformance with applicable building codes.

Kathy Teris

Printed Name of signature owner

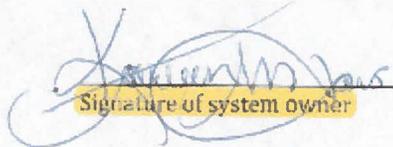
Signature of system owner

Simplified Process Interconnection Application and Service Agreement

Contact Information:

Date Prepared: 8/21/15

Legal Name and Address of Interconnecting Customer (or, Company name, if appropriate):

Customer or Company Name (print): Kathy Taris

Contact Person, if Company:

Mailing Address: 19 May Ln

City: Pelham

State: NH

Zip Code: 03076

E-Mail: kmtaris@gmail.com

Telephone (Daytime): (603) 508-2782

(Evening):

Facsimile Number:

Alternative Contact Information (e.g., system installation contractor or coordinating company, if appropriate):

Name: Granite State Solar

Mailing Address: 197 North Main St

City: Boscawen

State: NH

Zip Code: 03303

E-Mail: justin@granitestatesolar.com

Telephone (Daytime): (603) 369-4318

(Evening):

Facsimile Number:

Electrical Contractor Contact Information (if appropriate):

Name:

Telephone:

Mailing Address:

City:

State:

Zip Code:

Facility Information:

Address of Facility: 19 May Ln

City: Pelham

State: NH

Zip Code: 03076

Electric Supply Co: Liberty

Acct #: 44619107-44327282

Meter #: 14 090 907

Gen/Inverter Manu: Enphase

Model Name and #: m280

Quantity: 24

Nameplate Rating: ~~250~~ (kW)

0.280 (kVA)

(AC Volts)

Single or Three

Phase

System Design Capacity: ~~6~~ (kW)

6.72 (kVA)

Battery Backup: Yes: No:

Net Metering: If Renewably Fueled, will the account be Net Metered? Yes: No:

Prime Mover: Photovoltaic

Recip'g Engine

Fuel Cell

Turbine

Other:

Energy Source: Solar

Wind

Hydro

Diesel

Nat Gas

Fuel Oil

Other:

UL 1741.1 (IEEE 1547.1) Listed? Yes: No:

External Manual Disconnect: Yes: No:


Estimated Install Date: September

Estimated In-Service Date: September

Interconnecting Customer Signature

I hereby certify that, to the best of my knowledge, all of the information provided in this application is true and I agree to the Terms and Conditions on the following page:

Customer Signature:



Title: Homeowner

Date: 8/23/2015

Please attach any documentation provided by the inverter manufacturer describing the inverter's UL 1741 listing.

Approval to Install Facility (For Company use only): Installation of the Facility is approved contingent upon the terms and conditions of this Agreement, and agreement to any system modifications, if required.

Are system modifications required? Yes: No: To be Determined

Company Signature:

Joel A Rivera

Title:

Engineering

Date:

2/26/16

Company waives inspection/Witness Test? Yes: No:

Application Number

2015-167

Dated: May 4, 2015

Effective: July 15, 2014


Issued by /s/ Richard Leehr

Richard Leehr

Title: President

Authorized by Order No. 25,638 Issued March 17, 2014 in Docket No. DE 13-063

7.56 Kw Array
 24 LG 315 w modules
 24 Enphase S-280 micro inverters
 27.12 A output

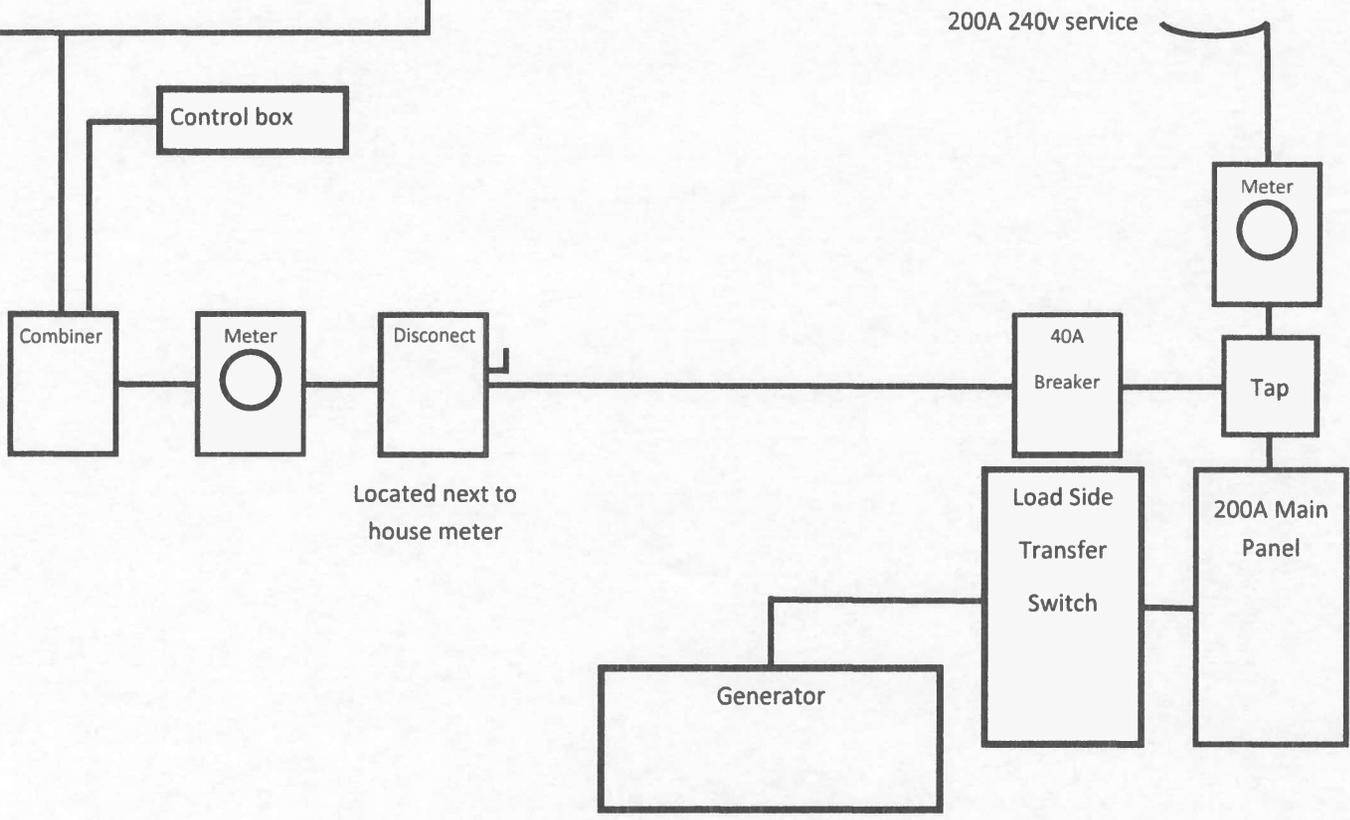

PREPARED BY:

Troy Diamond, Master Electrician

ADDRESS:

19 May Lane. Pelham, NH 03076

TITLE:

Taris, Kathy One Line

DATE:

2/25/2016

