



Report on Wires and Non- Wire Solutions to Address Reliability in the Bellows Falls Area – 2022

Docket No. DE 21-004

June 1, 2022





Table of Contents

Section 1: Executive Summary	1
Section 2: History	3
Section 3: Analysis of Utility System Benefits	4
Section 4: Risk Scoring	4
Section 5: Additional Source Solutions	5
Section 6: Evaluation	11
Section 7: Findings	13



Section 1: Executive Summary

Liberty Utilities (Granite State Electric) Corp. (“Liberty” or the “Company”) completed a solution assessment on one of its worst-performing areas in reliability, Bellows Falls. The purpose of the study was to assess the last five (5) years of outage data and identify potential solutions to improve reliability for our customers in this area.

Because the Company’s analysis is based on historical data, the effect of planned improvements in the Bellows Falls area are not captured. As discussed below, the Company has already committed to system hardening investments and changes to our vegetation management strategies that are expected to improve reliability. The solutions described herein are in addition to those enhancements.

One major driver complicating a solution for the reliability issues in the Bellows Falls area is the inability to perform the necessary system reconfiguration to isolate system faults and reduce the number of customers impacted during an event.

The Company undertook analyses of thermal loading, voltage, reliability, asset condition, power quality, environmental, safety, and voltage performance. Six solutions were identified to address the reliability issue, three of which being traditional wires solutions and three being non-wires solutions (NWS).

The table below shows the possible solutions, with a brief description of each option and estimated cost.

Table 1: Potential Solutions

Liberty NWS Evaluation Workbook: Solutions		
Problem	With the loss of the 12L1 and 12L2 or pole top reclosers, downstream customers would be out of power for the duration of the outage.	
Option	Solution	Cost
1 Forrest Road Tie Line	3-phase line extension to provide circuit tie within the 12L1 (3.9 miles)	\$1,978,800
2 Prospect Hill Rd Tie Line	3-phase line extension to provide circuit tie within the 12L1 and 12L2 (7.5 miles)	\$3,825,000
3 Acworth Rd Tie Line	3-phase line extension to provide circuit tie within the 12L1 and 12L2 (9 miles)	\$4,590,000
4 BTM Storage	Behind the meter storage - 2 MW	\$4,509,000
5 8MWh Storage	Install battery storage for 12L1 and 12L2	\$8,300,000
6 16 MWh Storage	Install battery storage for 12L1 and 12L2	\$15,200,000

The cost estimates for battery storage options 5 and 6 were derived through industry data from a consultant the Company engaged for assistance in determining costs associated with these



Wires and Non-Wires Solutions – Bellows Falls

solution options. The behind the meter battery solution Option 4 cost estimate was calculated using previous cost data the Company had available through the Company's battery pilot program. Solution 4 costs are based on 200 customers and an installation cost of \$22,545 per home.

The Company used the evaluation criteria and weighting factors as outlined in the January 14, 2021, LCIRP filing on Bates 318–319 to assess the solutions and a summary of the results is shown in the table below. Each of the options and the detailed analysis is presented later in this report. The report provides the direction in which the Company believes is most viable at this time. Solutions three and four provides the greatest potential for increasing reliability.

Table 2: Evaluation Summary

Evaluation Summary							
Evaluation Criteria	% Weight Factor	Option 1	Option 2	Option 3	Option 4	Option 5	Option 6
Cost/Benefit Comparison	30%	2	3	4	2	2	1
Reliability Risk	20%	1.50	2.60	3.40	1.20	2.00	2.00
Feasibility Risk	20%	2.35	3.00	3.25	2.35	2.25	2.25
Performance Risk	20%	2.80	3.00	3.20	2.35	2.40	2.40
Environmental Risk	10%	2.25	2.50	2.50	4.00	3.00	3.00
Total Assessment	100%	2.16	2.87	3.42	2.18	2.23	1.93

Based on the total assessment scoring results, Option three (3) scored the highest. It is important to note that all of the traditional wires solutions scored higher than any non-wires solution. This is due to the current estimated reliability impact performance that the batteries can potentially provide as opposed to a traditional wires solution.

Option three (3) consists of installation of a nine-mile 3-phase line extension in 2026 with a circuit tie between the 12L1 and 12L2. This solution affords the best opportunities to conduct restoration switching should a permanent upstream fault occur on either circuit breaker or two of the pole-top reclosers on the 12L1 circuit.

Currently, only 19.5% of the 12L1 circuit and 31.2% of the 12L2 circuit have 3-phase primary, as compared to the rest of the Company's circuits average of 49.3%. To provide the most reliable service, creating 3-phase circuit ties is the appropriate course of action. This installation will also provide a greater footprint of 3-phase primary for future distributed generation installations. By the Company's estimation, this will improve circuit outage duration ("Ckaidi") for reportable customer interruptions in this region by approximately 6%. The Company intends to implement



distribution automation once the tie has been constructed to modernize the circuits and greatly improve the customer experience.

Based on the information available at the time of this analysis, the Company has identified the preferred solutions to investigate further to resolve reliability in the Bellows Falls area to Options 3 and 4. The next step of the adjudicative process will be to work with interested parties to further investigate each option.

Section 2: History

In Docket No. DE 19-120, the Settlement Agreement provided that prior to filing its next Least Cost Integrated Resource Plan (LCIRP), the Company was to develop a list of planned capital projects that may be candidates for avoidance and/or deferral through deployment of a non-wires solution (“NWS”). Once the NWS candidates were initially identified by Liberty, the Company agreed to meet with the settling parties to identify an NWS candidate that should be the focus of a more detailed analysis provided within the LCIRP filing. The Settlement Agreement specified the analysis of NWS should consider utility system benefits including, but not limited to, avoided distribution capacity costs, avoided energy costs, and avoided transmission costs. The analysis was to also include an evaluation of the demand reduction potential associated with energy efficiency and load curtailment, as well as other NWSs. The Commission approved the Settlement Agreement in Order No. 26,408 (Sept. 23, 2020).

The Company filed an NWS on January 14, 2021, which included the building of a microgrid to manage the potential loss of supply in the Bellows Falls area with the assumption that the full analysis would be filed on July 14, 2021, or six months after the initial filing, as provided in the Settlement Agreement. On June 15, 2021, the Commission Staff (now Department of Energy) requested the docket be suspended due to the loss of engineering expertise. Subsequently, a new procedural schedule was approved on October 15, 2021, which provided that the Company would file its analysis for the NWS on February 18, 2022.

During the period of October 2021 through February 2022, the Company reviewed its reliability data for the Bellows Falls area and determined more analysis needed to be completed due to the reliability in the area becoming more troubling over the prior twelve months. The NWS proposed on January 14, 2021, would not have addressed reliability issues in the area, it would only have addressed the loss of a supply line from Liberty’s transmission provider, National Grid. As such, the Company filed a request to postpone the filing of the NWS. The Commission ordered that the Company file a report on the dire situation in Bellows Falls on May 2, 2022, and to submit its NWS analysis by June 1, 2022.



As described in the Company's May 2, 2022, Bellows Fall Reliability Report, the largest cause of outages for the circuits that serve the Bellows Falls area is vegetation-related (Bates 8). The Company has identified traditional wires solutions to mitigate the reliability issues in its plans for 2022, along with several NWS for future years.

Section 3: Analysis of Utility System Benefits

Utility system benefits for non-wires solutions are qualitative and quantitative in nature. Solution options 1 through 3 that are presented further in this report are traditional wires solutions and as a result, did not include analyses of avoided distribution capacity costs, avoided energy costs, avoided transmission costs, demand reduction associated with energy efficiency and load curtailment. These traditional wires solutions are focused on system reliability given the data presented in the Company's May 2, 2022, report and, since they are wires solutions, there are no avoided costs associated with these projects.

Solutions 4 through 6 are the non-wires solutions and thus may have avoided distribution capacity costs, avoided energy costs, avoided transmission costs, and load curtailment during peak periods. However, the Company did not analyze these cost reductions because the construction costs for solutions 5 and 6 are significantly higher than solutions 1 through 4. Solution 4 is based on the Company's Phase 1 of the battery storage pilot and the analysis of Phase 1 will be completed and filed on August 31, 2022. With regard to demand reduction associated with energy efficiency, the Company did not analyze the impact because the issues in the area are not capacity driven, which could benefit from energy efficiency, but are reliability driven, which energy efficiency cannot solve.

Section 4: Risk Scoring

As part of the Company's capital planning process, a risk score is assigned to determine the prioritization of a project. The Company looks at the following factors when calculating the risk score. The matrix includes the likelihood of an event occurring and the impact of that event. The following types of factors are reviewed:

- Frequency of interruptions or failures;
- Duration of outages;
- Customer count of each outage;
- Cost to repair the outage or failure;
- Whether the failure is at the system level, such as at the substation, or is isolated to a pocket on a circuit.



The Company utilizes the following matrix for risk scoring, with the higher numbers indicating higher risk:

Table 3: Risk Calculation Matrix

Likelihood	>Once in 100 yrs	Once in 20-100 yrs	Once in 10-20 yrs	Once in 5-10 yrs	Once in 3-5 yrs	Once in 1-3 yrs	>Once in 1 yr
Likelihood	1	2	3	4	5	6	7
Impact	Risk Value						
1	1	2	4	7	11	12	13
2	3	6	8	16	18	23	24
3	5	10	14	21	27	30	31
4	9	17	19	28	34	36	37
5	15	22	26	35	39	41	42
6	20	29	33	40	44	45	46
7	25	32	38	43	47	48	49

Section 5: Additional Source Solutions

The Bellows Falls Reliability Report filed on May 2, 2022, identified near-term mitigation efforts to address the reliability issues on the 12L1 and 12L2 circuits consisting of vegetation management and reconductoring work. That work will address the frequency of outages resulting in some improvement of reliability in the area. However, it does not address the need for a supplemental supply source to mitigate long-duration outages. This section describes and compares wires and non-wires options necessary to take the next step toward resolving the reliability issues in the Bellows Falls area. That next step in the reliability strategy is to create another source located near the back end of the main line portion of the circuit. Such a new source could come from either battery storage or a 3-phase line extension with circuit tie between the 12L1 and 12L2. The circuit tie would make it possible to conduct restoration switching should an upstream main line fault occur. The battery storage solution – installing a battery toward the end of the circuit of a sufficient size to serve customers while an outage is being repaired – could provide the same benefit as a circuit tie, without the construction of the three-phase line extension.

The primary benefit of battery storage over a line extension would be avoiding the cost of setting new poles and running the new conductor. A secondary benefit, is that the batteries could be dispatched for peak shaving, lowering overall transmission costs. A third benefit could be that the battery storage system would be scheduled to charge overnight when energy costs are cheaper and then dispatched onto the system during high demands when prices of energy are more expensive..




Wires and Non-Wires Solutions – Bellows Falls

The disadvantage of battery storage is the limited number of hours the supply would be available should a long-term outage occur for a given portion of the circuit, which is a problem that can be exacerbated depending on the state of the battery's charge or discharge when the fault occurred.

The 12L1 and 12L2 circuits tend to have lengthy outages. As depicted in the figure below, approximately 30 percent of the outages which occur on 12L1 and 12L2 are greater than 4 hours in length. Therefore, an NWS at full charge could potentially only resolve approximately 70 percent of customer outages.

Figure 1: 12L1 and 12L2 Outage Durations in Hours from 2017–2021

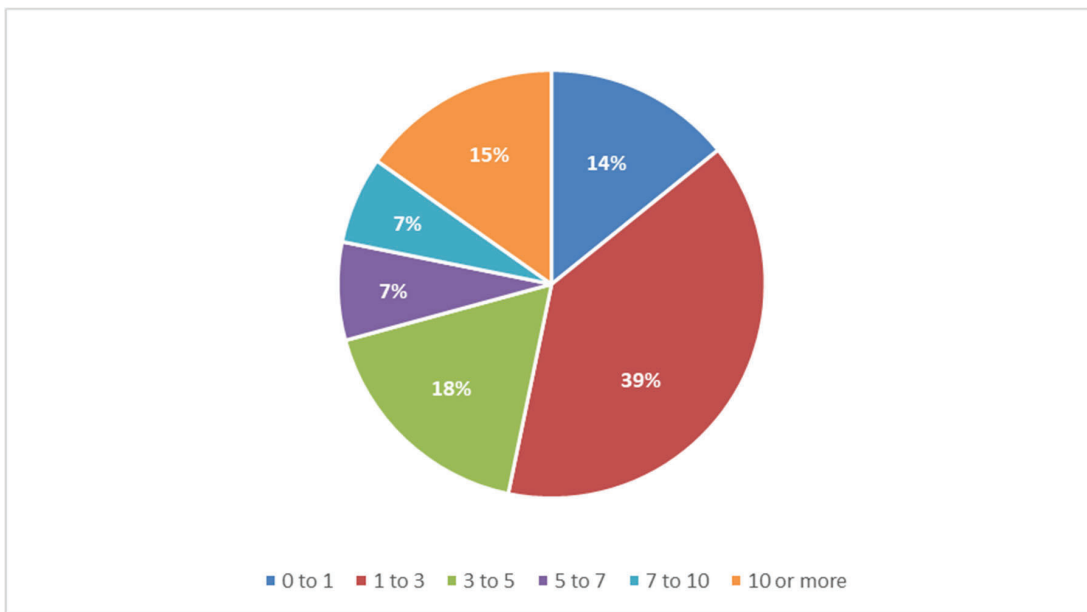

The Company identified six solutions to address the reliability issues on the 12L1 and 12L2 circuits. Each solution is reviewed in more detail below.

Solution #1: Forrest Road, Acworth – \$1,978,000

The first proposed wires solution is to extend the 12L1 approximately 3.9 miles along Forrest Road to create a circuit tie from Forrest Road, Acworth, to Forest Road in Alstead. The benefit of this option would be to provide a tie to two radial sections on the back end of the 12L1 circuit, beyond two pole-top reclosers. This project would provide the ability to conduct switching should either section experience a fault. One disadvantage of this option is that it would not provide a backup source should one of the pole top reclosers upstream, or the 12L1 circuit breaker itself, lock out. Also, there is a portion of this project that would travel through a small area that does not currently



Wires and Non-Wires Solutions – Bellows Falls

have any poles or wire. The Company would need to obtain the necessary easements and/or licenses to install its equipment in this section.


This project would involve reconductoring of approximately 3.9 miles at a cost of approximately \$1,978,000, with a risk score of 24. The following table provides estimated increased reliability post-construction. The cost of the project is \$15,418 per customer interruption and \$69 per customer minute saved.

Table 4: Estimated Reliability Results for Forrest Road

Circuit Reliability Impacts Post Construction		
	<u>No Exclusion</u>	<u>Puc 307.07 Exclusion</u>
Frequency	N/A	N/A
Duration	-3%	-3%
\$/dCI	\$12,032	\$15,418
\$/dCMI	\$60	\$69

Figure 2 below shows the proposed circuit tie between the I2L1 and I2L2 circuits.

Figure 2: Proposed Circuit Tie

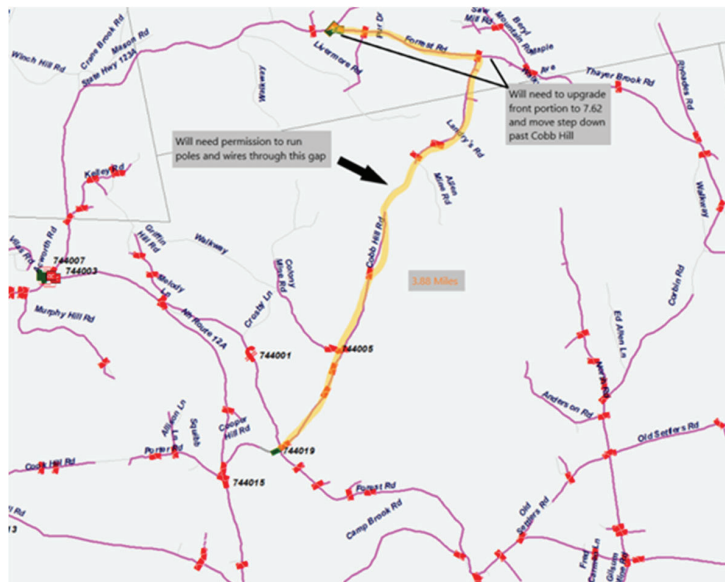

Solution #2: Route 123 – Watkins Hill Road – \$3,825,000

The second proposed wires solution is to construct a 7.5 mile, 3-phase line extension from the I2L1 circuit at Route 123, Walpole, to the I2L2 circuit at Watkins Hill Road, Walpole. This would create a



Wires and Non-Wires Solutions – Bellows Falls

circuit tie beyond a pole top recloser for each circuit. The benefit of this option is that it would not only put the tie in a zone not covered by the circuit breaker, but it affords the Company the ability to utilize distribution automation. As it stands now, the circuit breakers at Vilas Bridge are the protective upstream devices for the current tie.

The disadvantage of this option is that it would not affect outage frequency, it would only improve duration.

This project would consist of reconductoring approximately 7.5 miles at a cost of \$3,825,000, with a risk score of 30. The following table provides estimated increased reliability post-construction and cost per interruption. The cost of the project is \$7,889 per customer interruption and \$39 per customer minute saved.

Table 5: Estimated Reliability Results for Route 123 – Watkins Hill Road

Circuit Reliability Impacts Post Construction		
	<u>No Exclusion</u>	<u>Puc 307.07 Exclusion</u>
Frequency	N/A	N/A
Duration	-9%	-6%
\$/dCI	\$4,172	\$7,889
\$/dCMI	\$28	\$39



Wires and Non-Wires Solutions – Bellows Falls

Figure 3 below shows the proposed circuit tie between the 12L1 and 12L2 circuits.

Figure 3: Proposed Circuit Tie



Solution #3: Route 12A – Watkins Hill Road – \$4,590,000

The third proposed wires solution is to construct a 9 mile, 3-phase line extension from the 12L1 circuit at Route 12A, Alstead to the 12L2 circuit at Watkins Hill Road in Walpole. The benefits of this option is that it would create a more useful circuit tie in the more rural areas of both the 12L1 and 12L2 circuits and allow the Company to utilize distributed automation for multiple zones. This tie not only is in the optimum location for both circuits but puts 3-phase primary throughout a much larger area which would give more opportunities for future distributed generation interconnection.

This project would reconductor approximately 9 miles at a cost of about \$4.6 million, with a risk score of 37.

The following table provides estimated increased reliability post-construction and cost per interruption. The cost of the project is \$9,467 per customer interruption and \$46 per customer minute saved.

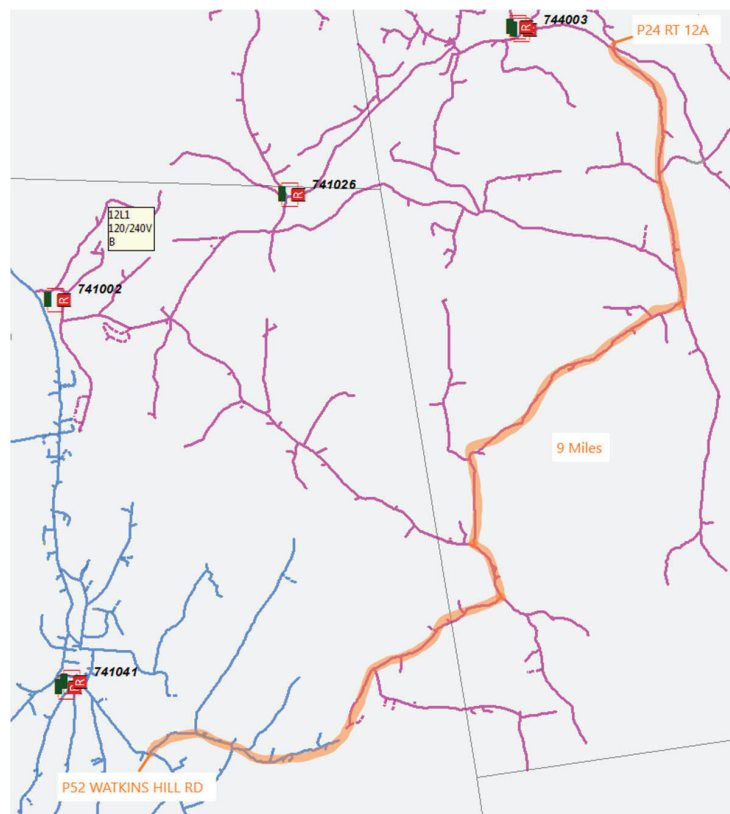


Table 6: Estimated Reliability Results for Acworth Road

Circuit Reliability Impacts Post Construction		
	<u>No Exclusion</u>	<u>Puc 307.07 Exclusion</u>
Frequency	N/A	N/A
Duration	-12%	-6%
\$/dCI	\$3,558	\$9,467
\$/dCMI	\$25	\$46

Figure 4 below demonstrates the proposed circuit tie between the 12L1 and 12L2 circuits.

Figure 4: Proposed Circuit Tie



Solution #4: Targeted Battery Storage Implementation

One non-wires solution option to avoid constructing a circuit tie would be to install batteries on every customer downstream of the affected protective device. Similar to the Company's Phase 1 battery storage pilot program, these individual customer batteries could be designed to provide



Wires and Non-Wires Solutions – Bellows Falls

storage for each home and business on the circuit whereby the customers would participate in the same manner as the Phase 1 battery storage pilot customers.

The benefits of this option is that it would avoid construction of the wires solution and, if successful, would provide back-up power during an outage. The disadvantage is that it would not solve the issue of poor reliability in the area.

Using cost data from the Company's Phase 1 battery storage pilot, for approximately 200 customers the total cost of this project would be \$4,509,000. Of this amount, \$1,200,000 would be provided by the customers at a cost of \$6,000 each. The remaining \$3,309,000 would be paid for by Liberty. These estimated costs were derived from the Company's Phase 1 costs for 100 customers participating and tailoring it to 200 customers participating. The Company is still in the initial stages of phase 1 of the battery storage pilot program and will continue to evaluate the costs and benefits of this pilot to determine if this non-wires solution is a comparable alternative to a wires solution.

Solution #5: 8MWh Storage

A second non-wires solution option is to provide a backup storage source to one portion of each circuit. A 2 megawatt, 4-hour battery storage system (8 MWh), without the costs to purchase the site and perform site work, is approximately \$4,150,000 each, or \$8,300,000 for two. Given that this would act as a circuit tie, a battery on each circuit is necessary to feed both circuits.

Given this high cost, the Company did not evaluate this option further. The Company will continue to monitor the commodity pricing for battery storage. If the cost of this option comes down in the coming years, the Company will once again evaluate this solution as an alternative to a wires solution.

Solution #6: 16MWh Storage

A third non-wires solution is to install sufficient battery storage at the end of the 3-phase main line for both circuits, to provide a replacement for a circuit tie. The 12L1 and 12L2 circuits each peak at over four megawatts. A 4 megawatt, 4-hour battery storage system (16 MWh), without the purchase of the site or cost of site work, is approximately \$7,600,000 each, or \$15,200,000 for two.

Section 6: Evaluation

The following tables show the criteria for the evaluation of the six potential solutions. The Company ranked each solution according to cost, reliability, feasibility, performance, and environmental risks. Each criterion was broken down into multiple components, with weighted percentages, and



Wires and Non-Wires Solutions – Bellows Falls

scored one through four. These tables were then combined for a total assessment of each solution.

Table 7: Key for Evaluation of Solutions 1 through 6

Project Scope	Option
3-phase line extension to provide circuit tie within the 12L1 (3.9 miles)	1
3-phase line extension to provide circuit tie between 12L1 and 12L2 (7.5 miles)	2
3-phase line extension to provide circuit tie between 12L1 and 12L2 (9 miles)	3
Acquire customer participation in behind the meter battery storage program	4
Install 8 MWh battery storage connected at the far end of 3-phase battery storage for 12L1 and 12L2	5
Install 16 MWh battery storage connected at the far end of 3-phase battery storage for 12L1 and 12L2	6
Scoring Definitions	
	Values
Marginal with mitigation	1
Marginal without mitigation	2
Acceptable	3
Best Solution	4

Table 8: Summary Evaluation of Solutions 1 through 6 (higher number is better)

Evaluation Summary							
Evaluation Criteria	% Weight Factor	Option 1	Option 2	Option 3	Option 4	Option 5	Option 6
Cost/Benefit Comparison	30%	2	3	4	2	2	1
Reliability Risk	20%	1.50	2.60	3.40	1.20	2.00	2.00
Feasibility Risk	20%	2.35	3.00	3.25	2.35	2.25	2.25
Performance Risk	20%	2.80	3.00	3.20	2.35	2.40	2.40
Environmental Risk	10%	2.25	2.50	2.50	4.00	3.00	3.00
Total Assessment	100%	2.16	2.87	3.42	2.18	2.23	1.93

Table 9: Reliability Risk Evaluation

IDENTIFIED PROBLEM: CONTINGENCY LOSS 12L1 or 12L2							
Reliability Risk	% Weight Factor	Option 1	Option 2	Option 3	Option 4	Option 5	Option 6
Customer Outage Experience	50%	2	3	4	1	2	2
Automated Restoration	30%	1	3	4	1	2	2
Power Quality	20%	1	1	1	2	2	2
Totals	100%	1.50	2.60	3.40	1.20	2.00	2.00



Table 10: Feasibility Risk Evaluation

NWA COST/RISK EVALUATION SUMMARY							
Feasibility Risk	% Weight Factor	Option 1	Option 2	Option 3	Option 4	Option 5	Option 6
Likelihood of Timely Completion	35%	2	3	3	3	3	3
Predictable Long Term Solution	25%	3	3	4	2	2	2
Historical Field Experience	10%	3	3	3	2	1	1
Operational Uncertainty	30%	2	3	3	2	2	2
Totals	100%	2.35	3.00	3.25	2.35	2.25	2.25

Table 11: Performance Risk Evaluation

NWA COST/RISK EVALUATION SUMMARY							
Performance Risk	% Weight Factor	Option 1	Option 2	Option 3	Option 4	Option 5	Option 6
Availability	35%	3	3	3	3	2	2
Operability	25%	3	3	3	2	2	2
Policy Alignment	20%	3	3	3	3	3	3
DER Integration	20%	2	3	4	1	3	3
Totals	100%	2.80	3.00	3.20	2.35	2.40	2.40

Table 12: Environmental Risk Evaluation

NWA COST/RISK EVALUATION SUMMARY							
Environmental Risk	% Weight Factor	Option 1	Option 2	Option 3	Option 4	Option 5	Option 6
Wetland Impact	25%	2	2	2	4	3	3
Tree Clearing	25%	2	2	2	4	3	3
Community Impacts	25%	3	3	3	4	3	3
Municipal Impacts	25%	2	3	3	4	3	3
Totals	100%	2.25	2.50	2.50	4.00	3.00	3.00

Section 7: Findings

This report's key findings can be summarized as follows:



Wires and Non-Wires Solutions – Bellows Falls

- Of the investments that could be made to mitigate the reliability issues in the Bellows Falls area, the Acworth Rd. Tie Line (Option 3) and BTM Storage (Option 4) have the lowest costs.
- The cost estimates presented herein are based on the best data currently available to the Company but do not reflect actionable quotes from vendors. The actual cost to implement any of the solutions described herein cannot be precisely known at this time.
- The solutions in this report create reliability benefits insofar as they mitigate the service risks to customers in the Bellows Falls area. Many would also create economic benefits by reducing the Company's cost to operate the electric system on customers' behalf. Those benefits have not been evaluated for this report and cannot be known with certainty at this time.
- As described above and in the May 2, 2022, Bellows Falls Reliability Report, the Company has plans to perform tree trimming in 2022 and invest in two near-term future reconductoring projects which are expected to significantly improve reliability in the Bellows Falls area.

The Company intends to continue to monitor the Bellows Falls area with emphasis on understanding the effectiveness of the reconductoring investments and vegetation management plan to improve system reliability. If further enhancements are required, the Company expects to rely on this analysis to guide decision-making regarding next steps.



Liberty Utilities (Granite State Electric) Corp. d/b/a Liberty

Company	Priority	Category	Project	Project Name	2023 Through 2027 (Five Year) Capital Plan					
					Total 2023	Total 2024	Total 2025	Total 2026	Total 2027	
8830-0000	5	Discretionary	LU CapEx - Improvement	GSE_00002	12L1-12L2 Battery Storage	-	-	-	-	100,000
8830-0000	5	Discretionary	LU CapEx - Improvement	GSE_00003	Barron Ave Substation- Decommission & Removal	-	-	500,000	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	GSE_00005	Salem Depot Substation- Decommission & Removal	-	-	500,000	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00001	Air Break Switch Upgrade Program	-	150,000	-	-	-
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00002	01659 Granite St Meter Purchases	500,000	515,000	530,450	546,364	562,754
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00003	01660 Granite St Transformer Purchases	1,030,221	1,030,221	1,030,221	1,030,221	1,030,221
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00004	01663 GS Storm Program Proj	-	300,000	309,000	318,270	327,818
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00005	01737 GSE-Dist-Subs Blanket	-	523,023	535,068	551,120	567,654
8830-0000	5	Discretionary	LU CapEx - Replenishment	NH_00006	Add on to Garage in Salem	-	82,400	82,400	-	-
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00007	Dist-Damage&Failure Blanket	1,903,730	2,260,000	2,121,800	2,185,454	2,251,018
8830-0000	2	Mandated	LU CapEx - Improvement	NH_00008	Distribution Feeder Power Factor Correction	-	50,000	50,000	75,000	77,250
8830-0000	2	Mandated	LU CapEx - Improvement	NH_00010	GSE Distributed Generation Blanket	50,000	50,000	50,000	50,000	50,000
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00011	GSE-Dist-3rd Party Attach Blanket	200,000	206,000	212,180	218,545	225,102
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00012	GSE-Dist-Asset Replace Blanket	400,000	463,500	477,405	491,727	506,479
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00013	GSE-Dist-Land/Land Rights Blanket	-	2,060	2,122	2,185	2,251
8830-0000	2	Mandated	LU CapEx - Improvement	NH_00014	GSE-Dist-Load Relief Blanket	-	209,090	212,180	218,545	225,102
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00015	GSE-Dist-Meter Blanket	-	5,150	5,305	5,464	5,628
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00016	GSE-Dist-Public Require Blanket	500,000	568,218	585,265	602,823	620,907
8830-0000	2	Mandated	LU CapEx - Improvement	NH_00017	GSE-Dist-Reliability Blanket	500,000	778,305	798,564	822,521	847,197
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00018	GSE-Dist-St Light Blanket	125,000	125,000	128,750	132,612	136,591
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00019	GSE-Dist-Telecomm Blanket	-	2,575	2,652	2,732	2,814
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00020	Install Lebanon 112 Feeder Tie - Plainfield	-	75,000	1,500,000	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00021	Install Lebanon 112-113 Feeder Tie	-	345,000	-	-	424,360
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00022	Install Vilas Bridge 12L1-12L2 Feeder Tie	-	-	75,000	6,000,000	-
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00024	NN D-Line Work Found by Insp.	-	50,000	50,000	51,500	53,045
8830-0000	2	Mandated	LU CapEx - Improvement	NH_00025	Security Conversion GSE	25,000	-	-	-	-
8830-0000	3	Growth	LU CapEx - Growth	NH_00026	GSE-Dist-New Bus-Comm Blanket	1,500,000	1,822,984	1,671,673	1,721,823	1,773,478
8830-0000	3	Growth	LU CapEx - Growth	NH_00027	GSE-Dist-New Bus-Resid Blanket	1,500,000	2,228,730	2,089,592	2,152,279	2,216,848
8830-0000	3	Growth	LU CapEx - Growth	NH_00030	Install Service to Tuscan Village South Line	1,000,000	1,000,000	-	-	-
8830-0000	5	Discretionary	LU CapEx - Replenishment	NH_00031	PS&I Activity - New Hampshire	-	100,000	100,000	100,000	100,000
8830-0000	3	Growth	LU CapEx - Growth	NH_00032	Reserve for New Business Commercial Unident specific & SC	-	159,135	159,135	-	-
8830-0000	3	Growth	LU CapEx - Growth	NH_00033	Reserve for New Business Residential	-	159,135	159,135	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00037	SCADA and Distribution Automation	-	50,000	1,000,000	1,060,000	1,121,800
8830-0000	4	Regulatory	LU CapEx - Improvement	NH_00038	Bare Conductor Replacement Program	-	2,500,000	2,575,000	2,652,250	2,731,818
8830-0000	5	Discretionary	LU CapEx - Replenishment	NH_00042	23KV Cable Inspection and Replacement Program	-	50,000	50,000	51,500	-
8830-0000	5	Discretionary	LU CapEx - Replenishment	NH_00045	Feeder Getaway Cable Replacement	-	250,000	-	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00046	Finance Unalloc Burden	-	200,000	200,000	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00047	GSE Facilities Capital Improvements	200,000	600,000	600,000	618,000	636,540
8830-0000	2	Mandated	LU CapEx - Replenishment	NH_00048	GSE-Dist-Genl Equip Blanket	51,500	51,500	53,045	54,636	56,275
8830-0000	5	Discretionary	LU CapEx - Replenishment	NH_00049	IE-NN UG Structures and Equipment	-	150,000	150,000	154,500	159,135
8830-0000	5	Discretionary	LU CapEx - Replenishment	NH_00050	IE-NN URD Cable Replacement	-	1,600,000	1,648,000	1,697,440	1,748,363
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00051	IT Systems & Equipment Blanket	125,000	125,000	128,750	132,613	136,591
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00052	IT Systems Allocations - Corporate	50,000	50,000	50,000	51,500	50,000
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00055	Rebuild Lockhaven Rd Enfield Phase 1	-	-	400,000	1,000,000	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00056	Remove 1303 Line - Wilder Junction to Sachem Jct.	-	-	-	100,000	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00058	SCADA Data center upgrades	-	100,000	-	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00059	Transportation Fleet & Equip. Blanket	1,700,000	1,000,000	1,000,000	1,030,000	1,060,900
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00061	Rockingham West Circuit	3,000,000	-	-	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00062	AMI-meters	-	-	-	7,433,333	14,866,667
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00063	GSE Backup Battery Program	-	-	1,500,000	1,500,000	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00064	Reliability Projects (Bellows Falls, etc.)	3,790,000	6,210,000	-	-	-
8830-0000	5	Discretionary	LU CapEx - Improvement	NH_00065	AMI - Head-end	-	-	5,700,000	3,800,000	-
Totals						18,150,451	26,197,025	28,992,691	38,614,957	34,674,605

2023 Through 2027 Capital Placed in Service				
Total 2023	Total 2024	Total 2025	Total 2026	Total 2027
-	-	-	-	-
-	-	500,000	-	-
-	-	500,000	-	-
-	150,000	-	-	-
500,000	515,000	530,450	546,364	562,754
1,030,221	1,030,221	1,030,221	1,030,221	1,030,221
-	300,000	309,000	318,270	327,818
-	523,023	535,068	551,120	567,654
-	82,400	82,400	-	-
1,903,730	2,260,000	2,121,800	2,185,454	2,251,018
-	50,000	50,000	75,000	77,250
50,000	50,000	50,000	50,000	50,000
200,000	206,000	212,180	218,545	225,102
400,000	463,500	477,405	491,727	506,479
-	2,060	2,122	2,185	2,251
-	209,090	212,180	218,545	225,102
-	5,150	5,305	5,464	5,628
500,000	568,218	585,265	602,823	620,907
500,000	778,305	798,564	822,521	847,197
125,000	125,000	128,750	132,612	136,591
-	2,575	2,652	2,732	2,814
-	-	1,575,000	-	-
-	345,000	-	-	424,360
-	-	-	6,075,000	-
-	50,000	50,000	51,500	53,045
25,000	-	-	-	-
1,500,000	1,822,984	1,671,673	1,721,823	1,773,478
1,500,000	2,228,730	2,089,592	2,152,279	2,216,848
1,000,000	1,000,000	-	-	-
-	100,000	100,000	100,000	100,000
-	159,135	159,135	-	-
-	159,135	159,135	-	-
-	-	1,050,000	1,060,000	1,121,800
-	2,500,000	2,575,000	2,652,250	2,731,818
-	50,000	50,000	51,500	-
-	250,000	-	-	-
-	200,000	200,000	-	-
200,000	600,000	600,000	618,000	636,540
51,500	51,500	53,045	54,636	56,275
-	150,000	150,000	154,500	159,135
-	1,600,000	1,648,000	1,697,440	1,748,363
125,000	125,000	128,750	132,613	136,591
50,000	50,000	50,000	51,500	50,000
-	-	-	1,400,000	-
-	-	-	100,000	-
-	100,000	-	-	-
1,700,000	1,000,000	1,000,000	1,030,000	1,060,900
9,900,000	-	-	-	-
-	-	-	7,433,333	14,866,667
-	-	1,500,000	1,500,000	-
3,790,000	6,210,000	-	-	-
25,050,451	26,072,025	22,942,691	44,789,957	34,574,605

8830-0000 - Granite State Electric Company	GSE_00006	Corporate: Customer Experience/Big Data	198,396	371,055	371,055	409,037	226,047
8830-0000 - Granite State Electric Company	GSE_00007	Corporate: Total Rewards	18,579	33,064	11,021	-	-
8830-0000 - Granite State Electric Company	GSE_00008	Corporate: Corporate Communications	37,787	20,468	25,192	20,468	20,468
8830-0000 - Granite State Electric Company	GSE_00009	Corporate: Talent Acquisition	3,149	-	-	-	-
8830-0000 - Granite State Electric Company	GSE_00010	Corporate: Cybersecurity	1,292,125	2,063,334	1,060,312	206,678	206,678
Grand Totals			19,700,487	28,684,947	30,460,271	39,251,141	35,127,798

-	438,115	365,981	452,094	-
18,579	33,064	11,021	-	-
37,787	20,468	25,192	20,468	20,468
3,149	-	-	-	-
1,523,506	1,260,504	1,663,206	587,418	206,678
26,633,472	27,824,177	25,008,091	45,849,937	34,801,751

THIS PAGE INTENTIONALLY LEFT BLANK