



REV.	DATE	DR	CK	DESCRIPTION	
				Green Mountain Power 163 Acorn Ln, Colchester VT, 05446	
				TL 30 AERIAL VIEW	
				Generating Possibilities Together	
SCALE:	NTS	DRAWN BY:	KAH	APPROVED BY:	
DATE:	12/27/2019	CHECKED BY:			DATE
DRAWING NUMBER:					REV.
FILE:	L:\SUBSTATION				

ATTACHMENT 2 - PROPOSED NORTH BRATTLEBORO
69kV TAP RETIREMENT DIAGRAM

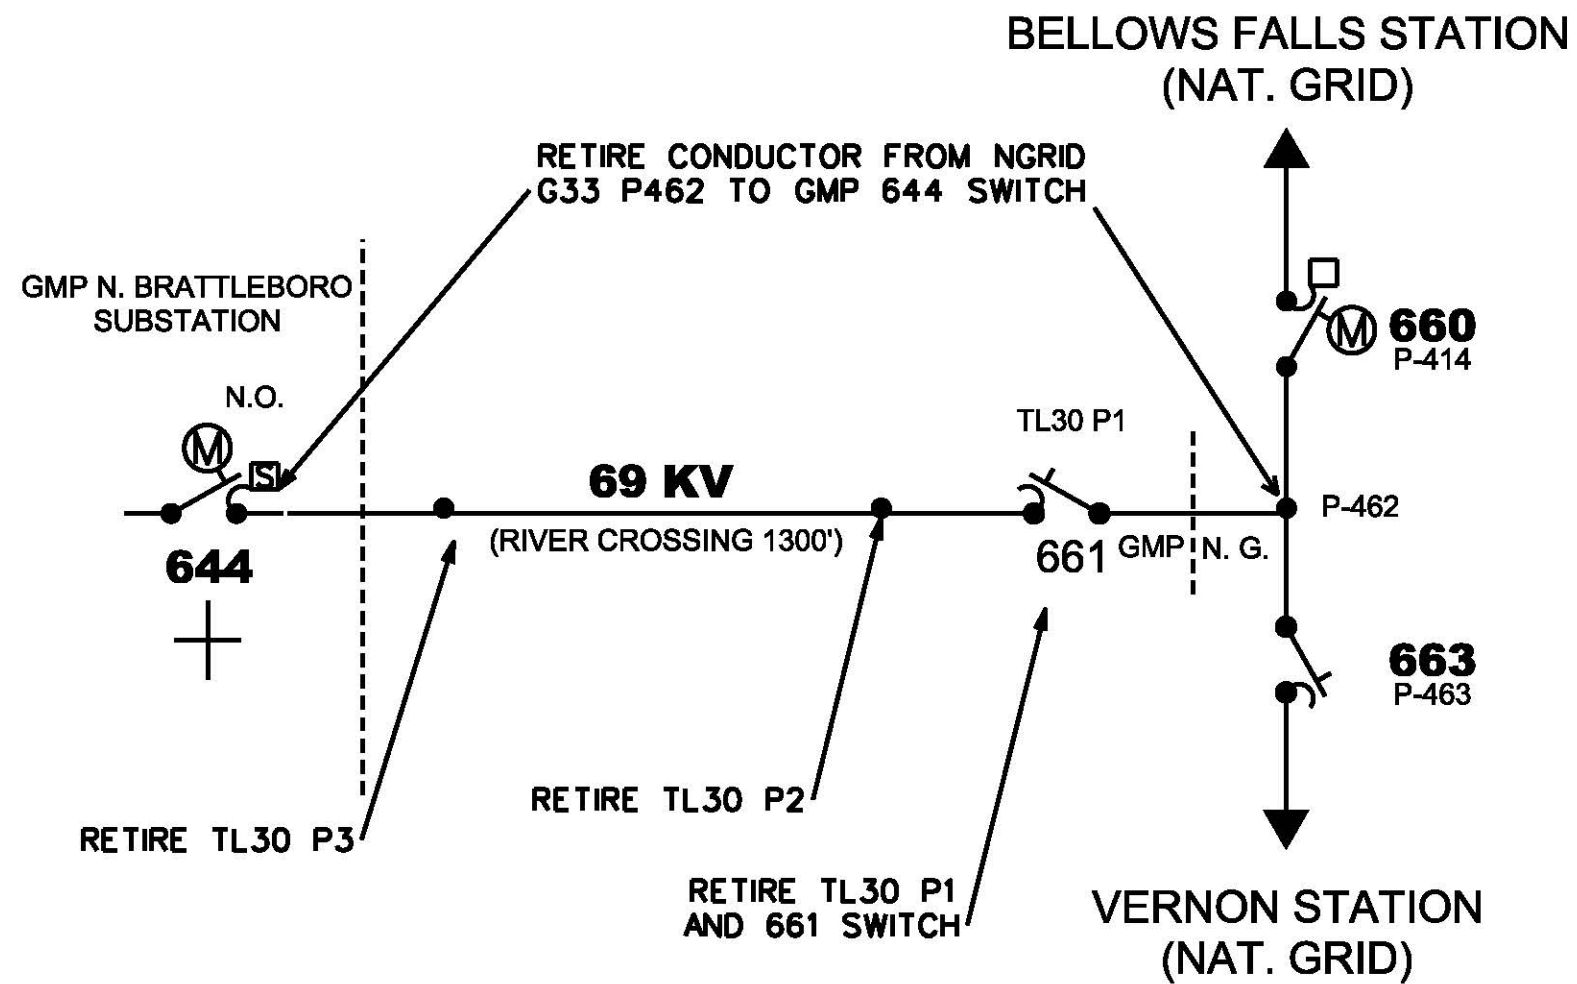

0					
REV.	DATE	DR	CK	DESCRIPTION	
<div><div><div><p>GREEN MOUNTAIN POWER <i>Generating Possibilities Together</i></p></div><div><p>Green Mountain Power 163 Acorn Ln, Colchester VT, 05448</p><p>PROPOSED GMP TL 30 RETIREMENT DIAGRAM</p></div></div></div>					
SCALE: NTS		DRAWN BY: KAH		APPROVED BY:	
DATE: 04/2020		CHECKED BY:		DATE:	
DRAWING NUMBER:				REV.	
FILE: 1.1SUBSTATION					

Geiger, Susan S.

From: Hassan, Kamran <Kamran.Hassan@greenmountainpower.com>
Sent: Monday, February 10, 2020 8:29 AM
To: Geiger, Susan S.; Smith, Maureen D.
Cc: Anderson, Carolyn; Fiske, John
Subject: FW: EXT || RE: N. Brattleboro 69kV transmission line retirement

Susan/Maureen,

Below is written confirmation that we have notified National Grid of our plan to retire our portion of the transmission line and their acceptance of that plan.

Thanks,
Kamran A. Hassan
Electrical Engineer
Green Mountain Power
802-353-9950

This email and any files transmitted with it are confidential and intended solely for the use of the individual or entity to who they are addressed. Furthermore, this e-mail and its attachments may contain CEII. The copying and distribution of CEII is strictly prohibited without the written consent of Green Mountain Power. If you are not the intended recipient, you are hereby notified that any retention, dissemination, distribution or copying of this communication and/or its attachments is strictly prohibited. Please reply to the sender that you have received the message in error and then delete it.

From: Murphy, Joseph <Joseph.Murphy3@nationalgrid.com>
Sent: Friday, February 7, 2020 4:43 PM
To: Hassan, Kamran <Kamran.Hassan@greenmountainpower.com>
Cc: Fiske, John <John.Fiske@greenmountainpower.com>
Subject: RE: EXT || RE: N. Brattleboro 69kV transmission line retirement

Hi Kamran,

Just a quick follow up. I was able to run this one to ground quickly. I have spoken with Transmission Planning and Protection Engineering. They are all set with you removing the tap from the G33 to GMP's North Brattleboro Substation. GMP will still need to work with PTO and Operations to put in the proper notice for any outages which would be needed to complete your removal. Please follow up as appropriate as your project proceeds.

Please let me know if you have any questions. Have a good weekend.

Best,

Joe